


655  
522  
345  
000e  
.2

a1002359368/b

VPI & SU LIBRARY

# Evaluation of Household Water Quality in Louisa County, Virginia

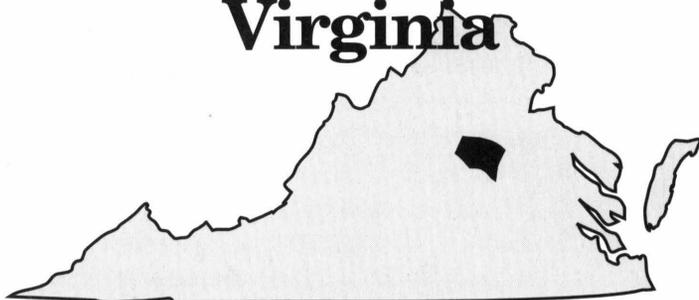

July 2000

Household Water Quality Series 43  
Department of Biological Systems Engineering  
Virginia Polytechnic Institute and State University  
Blacksburg, Virginia 24061-0303

**Virginia Cooperative Extension**



VIRGINIA POLYTECHNIC INSTITUTE  
AND STATE UNIVERSITY

Publication 442-933  
2000



VIRGINIA STATE UNIVERSITY

**LIBRARY**

VIRGINIA

POLYTECHNIC

INSTITUTE

AND

STATE

UNIVERSITY

# EVALUATION OF HOUSEHOLD WATER QUALITY IN LOUISA COUNTY, VIRGINIA

---

B. B. Ross<sup>1</sup>

J. E. Riddell<sup>2</sup>

P. H. Robinson<sup>2</sup>

K. R. Parrott<sup>3</sup>

A. C. Bourne<sup>4</sup>

---

Virginia Polytechnic Institute and State University  
Department of Biological Systems Engineering  
Household Water Quality Series 43

July 2000

<sup>1</sup> Professor, Dept. of Biological Systems Engineering, VPI&SU, Blacksburg, Virginia.

<sup>2</sup> Extension Agent, Louisa County, Louisa, Virginia.

<sup>3</sup> Associate Professor, Dept. of Near Environments, VPI&SU, Blacksburg, Virginia.

<sup>4</sup> Undergraduate Student Assistant, Dept. of Biological Systems Engineering, VPI&SU, Blacksburg, Virginia.

# Evaluation of Household Water Quality in Louisa County, Virginia

---

## ABSTRACT

During Summer and Fall 1999, a program of household water quality education, which included water sampling, testing, and diagnosis, was conducted in Louisa County, Virginia. Participation in the water quality program was made available to any Louisa County resident who utilized a private, individual water supply. During the course of the project, 383 households submitted water samples which were analyzed for iron, manganese, hardness, sulfate, chloride, fluoride, total dissolved solids, pH, saturation index, copper, sodium, nitrate, and total coliform and E. coli bacteria. These analyses identified the major household water quality problems in Louisa County as iron/manganese, corrosivity, and bacteria.

Following completion of the program, a survey was mailed to the 383 participants. One hundred and sixty-three participants returned survey forms on which they identified their reason(s) for participating in such a program; the primary reason being concern about safety of their water supply. Returned survey forms also provided insight into measures participants had already taken, or planned to take, to improve the quality of their water supply. More than three-fourths of the households who reported having at least one water quality problem had taken, or planned to take, at least one measure to improve the quality of their water supply. Eleven percent or more of all participants had taken, or planned to take, one or more of the following actions: shock chlorinate the water system, pump out septic tank, contact a state agency for additional assistance, and purchase or rent water treatment equipment.

LD  
5655  
A522  
A345  
2000e  
C. 2

## ACKNOWLEDGEMENTS

---

Many thanks are due the residents of Louisa County who participated in the educational program. Without their enthusiasm and cooperation, the program could not have succeeded. Appreciation is extended to Virginia Cooperative Extension, Louisa Office Program Support Technicians, Suzanne McGehee and Joanne Thompson for their assistance in program management, and Howard Evergreen, Louisa County Housing Foundation, and his staff for their assistance in making the program available to low-income residents. Special thanks are extended to all others who provided support in terms of publicity, encouragement, and interest, thus contributing to the success of the household water quality educational program. Financial support from the Chesapeake Bay Foundation is acknowledged. Appreciation is extended to Shirley Stewart, Louisa County Grant Writer, for preparing the successful grant proposal which provided funding to reduce the cost assessed to participants. Additionally, CSREES/USDA Water Quality Program Support 3-d funds were made available for this program.

Responsible for the majority of the water quality analyses, as well as coordination among the various labs and for much of the data management, was the Water Quality Laboratory of the Department of Biological Systems Engineering at Virginia Tech. Julie Jordan, Laboratory Supervisor, and her staff, are especially acknowledged for their efforts. Assisting with the general water chemistry analysis was the Soils Testing Laboratory of the Department of Crop and Soil Environmental Sciences at Virginia Tech.

Additional support from Virginia Tech should also be noted. Judy Poff of the Virginia Water Resources Research Center was instrumental in providing educational publications for participants at the public meetings. Joe Gray of the Virginia Cooperative Extension Distribution Center is appreciated for his assistance in preparing and mailing the evaluation survey packets to participants. Appreciation is due Diane Mahaffey for her efforts in preparing project forms and in typing this manuscript. In addition, Bev Brinlee and Tim FisherPoff are acknowledged for their editorial contributions.

# TABLE OF CONTENTS

---

|  |     |
|--|-----|
| ABSTRACT .....   | II  |
| ACKNOWLEDGEMENTS .....                                     | III |
| LIST OF FIGURES AND TABLES .....                           | V   |
| INTRODUCTION .....   | 1   |
| OBJECTIVES .....   | 2   |
| METHODS .....  | 2   |
| FINDINGS AND RESULTS .....                                 | 3   |
| Profile of Participant Households .....                    | 3   |
| Profile of Household Water Supplies .....                  | 4   |
| Participants' Perceptions of Household Water Quality ..... | 6   |
| Household Water Quality Analysis .....                     | 7   |
| General Water Chemistry Analysis .....                     | 7   |
| Bacteriological Analysis .....                             | 16  |
| Post-Program Survey .....                                  | 18  |
| Household Water Testing History .....                      | 18  |
| Reasons for Program Participation .....                    | 18  |
| Follow-up Activities Taken or Planned .....                | 19  |
| CONCLUSIONS .....  | 19  |
| REFERENCES .....   | 21  |
| APPENDIX .....   | 22  |

# LIST OF FIGURES AND TABLES

---

|           |  |    |
|-----------|--|----|
| Figure 1. | Educational Level Achieved by Participants .....   | 5  |
| Figure 2. | Family Income of Participants .....  | 5  |
| Figure 3. | Housing Environs of Participants .....   | 6  |
| Figure 4. | Household Water Treatment Devices Installed .....  | 9  |
| Figure 5. | Unpleasant Tastes Reported by Participants .....   | 9  |
| Figure 6. | Objectionable Odors Reported by Participants .....   | 10 |
| Figure 7. | Unnatural Appearance Reported by Participants. ....  | 10 |
| Figure 8. | Particles in Water Reported by Participants. ....  | 11 |
| Figure 9. | Staining Problems Reported by Participants .....   | 11 |
| Table 1.  | Average and Range of Concentration of Contaminants Comprising<br>General Water Chemistry Analysis .....  | 14 |
| Table 2.  | Percent of Concentrations Exceeding Established Standards for<br>Contaminants Comprising General Water Chemistry<br>and Bacteriological Analysis ..... | 15 |
| Table 3.  | Measures Taken or Planned by Participants, Since Water Quality Analysis,<br>to Improve Water Supply .....  | 17 |



# INTRODUCTION

---

The water supply and wastewater disposal requirements of the vast majority of rural homes and farms throughout Virginia are met by individual water supply and wastewater disposal systems. In Louisa County, for example, more than 85% of all housing units are served by individual water systems (Koebel et al., 1993). Virtually all of these homes depend on groundwater sources.

Throughout Louisa County, most wells were drilled only for farm or domestic water supply. George and Gray (1988) have estimated that 75% of Louisa County's drilled wells alone are inadequately constructed. It was also estimated that 3% of households have failing or inadequate waste disposal systems.

Louisa County has a land area of 498 square miles and lies wholly within the Piedmont physiographic province. Except for small portions of the county near its Southern, Southwestern and Western borders, the entire county drains into the North and South Rivers, major tributaries of the Pamunkey/York River system.

County population increased by 14% during the period 1980-90. Many new home sites are rural-based without public water and sewage services. As rural home sites encroach on agricultural land, the water supply becomes suspect to residents. Of equal importance is the potential failure of septic systems, since some home sites are on land less than ideal for a properly functioning septic system.

In addressing similar concerns, Ross et al. (1991) initiated a pilot program of household water quality education in Warren County, Virginia, which included water sampling, testing, and diagnosis. Based on requests and support from local interests, subsequent programs have been conducted in 59 additional counties. During the course of these projects, more than 8,500 households submitted water samples through local Virginia Cooperative Extension offices to be analyzed for the following: iron, manganese, hardness, sulfate, chloride, fluoride, total dissolved solids, pH, saturation index, copper, sodium, nitrate, and total coliform and fecal coliform/E. coli bacteria.

Major household water quality problems identified, as a result of these previous analyses, were determined to be iron/manganese, hardness, fluoride, and because of their potential health significance, corrosivity, bacteria, and to a lesser extent, sodium and nitrate, although the occurrence and extent of these problems varied across counties. In most county programs, a limited number of additional samples from "high-risk" households were tested for over two dozen pesticides and other chemical compounds. Most of these compounds have been detected in measurable quantities in one or more samples, with several values exceeding a corresponding U.S. Environmental Protection Agency Health Advisory Level (HAL) or Maximum Contaminant Level (MCL). It was the need to assess the current state of rural household water supplies in Louisa County, in addressing the above water quality issues, that led to the implementation of the Louisa County Household Water Quality Education Program.

# OBJECTIVES

---

The primary goal of this project was to conduct an educational program on household water quality to include water testing/diagnosis in Louisa County, Virginia. The general program objectives were to: (1) improve the quality of life of rural homeowners by increasing awareness and understanding of water quality problems, protection strategies, and treatment alternatives; and (2) create a groundwater quality data inventory to assist local governments in land use and groundwater management planning.

# METHODS

---

A household water quality educational program was offered through the local Virginia Cooperative Extension Office in Louisa, Virginia, during Summer and Fall 1999 to Louisa County residents who utilized private, individual water supplies. The program was patterned after the model developed under the pilot educational program completed in 1989 in Warren County (Ross et al., 1991). Local news media and agency newsletters publicized the program, and a program fact sheet was prepared (see Appendix).

The program was launched through meetings held in Holly Grove and Louisa in late May. Attendees of these initial meetings, who had paid \$15 per household water sample to be submitted (testing was made available to 100 low-income residents at no cost), were presented with information on local hydrogeologic characteristics in relation to groundwater pollution, likely sources of, and activities contributing to, groundwater contamination, the nature of household water quality problems (both nuisance and health-related), and specifics of the water testing program to follow. A second phase of the program was initiated by a similar meeting held in Louisa in late September.

Provisions were made to analyze up to 400 household water samples in Louisa County. Water sampling kits, for use by the participants themselves, were made available at the meetings and at the Louisa County Cooperative Extension Office after the meetings for late registrants. Two types of water sampling kits were distributed: (1) general water chemistry analysis for iron, manganese, hardness, sulfate, chloride, fluoride, total dissolved solids, pH, saturation index (Langlier), copper, sodium, and nitrate; and (2) bacteriological analysis (total coliform and E. coli).

The sampling kits included a 250 ml plastic bottle for general water chemistry samples and a sample identification form (see Appendix). The form included sampling instructions and a questionnaire on which participants were asked to describe the characteristics of their water supply. Also included in the kits was a 125 ml sterilized plastic bottle for bacteriological sampling. Instructions called for sampling from a drinking water tap and for flushing water systems prior to sampling to minimize contaminants contributed by the plumbing system. Persons who already had a water treatment device, such as a water softener, were requested to provide information about the type of equipment so that effective evaluation of their water quality and proper interpretation of results could be obtained, as further explained below.

Water samples were collected on June 1 at Holly Grove and on June 15 and October 12 at the Extension Office in Louisa. At the close of each collection day, all samples were packed in ice and immediately delivered to Virginia Tech in Blacksburg for analysis.

The water quality analysis was coordinated by the Department of Biological Systems Engineering Water Quality Laboratory at Virginia Tech. The Soils Testing Laboratory of the Department of Crop and Soil Environmental Sciences at Virginia Tech was subcontracted to analyze samples for several of the constituents. Water quality analyses were performed using standard analytical procedures (USEPA, 1979).

After the analysis had been completed, participants were reminded by mail to attend a subsequent meeting in Holly Grove in late June and in Louisa in early June and early November to obtain and discuss the test results and management practices to reduce or prevent water contamination. Complete test results were ultimately mailed to those participants who could not attend any of the meetings. A sample report form and accompanying report interpretation are shown in the Appendix.

At the conclusion of the program, an evaluation survey was mailed to participants (see Appendix). The objectives of the survey were to determine (1) the reasons for participation in the educational program and for having household water tested, and (2) what actions to correct water quality problems the participants had taken, or planned to take, as a result of participation in the program. Limited socio-economic information was also requested to obtain a profile of the total audience reached by the program.

In addressing overall project objective 2, local government and public officials were kept apprised of water quality test results, during the course of the program and at its completion. While the project was designed to involve voluntary participation, and quality control in sampling was not assured, the information gathered was nevertheless deemed useful for water quality assessment and planning at county and regional levels.

## **FINDINGS AND RESULTS**

---

During the course of the project, 383 individual household water samples were returned for general water chemistry and bacteriological analysis from all areas of the county. Two surveys were distributed to all water testing participants: One, the questionnaire with the water sampling kit, to be completed and returned by all participants with the sample submitted for analysis, and the other, an evaluation of the completed programs (see Appendix). For the latter, of the 383 forms mailed, 163 were returned (a 43% response rate). Both surveys provided insight into the characteristics of the households and their water supplies.

### **Profile of Participant Households**

The average length of the respondents' residence in Louisa County was 12 years. The length of residence reported ranged from 1 to 97 years. Forty-four percent of those responding had lived in Louisa County for 5 years or less. The size of the respondents' households ranged

from one to ten members; average household size was 2.26. It can, therefore, be estimated that more than 850 Louisa County residents were directly impacted by the water analysis/diagnosis aspect of the program.

More than one-half (57%) of the respondents were college graduates and nearly all of those indicating educational level achieved had at least a complete high school education (see Figure 1); facts that are not surprising, since it is likely that such individuals would have a greater awareness and understanding of water quality issues and be more likely to participate in such a program.

Participation in the program was on the high end of income distribution. Figure 2, which shows the family income (before taxes) of the respondents, indicates that a majority of the respondents exceeded the median family income (\$31,294 according to the 1990 Census) of Louisa County (Koebel et al., 1993). Twelve percent of respondents declined to indicate family income.

## **Profile of Household Water Supplies**


The initial survey answers, provided by all 383 participants in the water testing program, helped to characterize their water supplies (see Appendix). One set of questions dealt with the proximity of the household water supply to potential sources of groundwater contamination. One such question sought to define housing density, which may have an impact primarily from the standpoint of contamination from septic systems and related water quality problems. Participants were asked to classify their household environs as one of the following four categories, ranging from low to high density: (1) on a farm, (2) on a remote, rural lot, (3) in a rural community, and (4) in a housing subdivision. As shown in Figure 3, rural community (44%) was the most common and subdivision, selected by 16% of households, the least common.

Participants were also asked to identify potential contamination sources within 100 feet of their water supply. The major sources identified were septic system drainfields and home heating oil tanks, both identified by 14% of participants. Indications of proximity (within one-half mile) to larger activities, which could potentially contribute to groundwater pollution, were also sought. Agricultural activities were the most commonly identified; 22% of the participants indicated that their water supply was located within one-half mile of field crop production and 19% of a major farm animal operation.


Information was also obtained regarding characteristics of the participants' water supply systems. Regarding the type of water source supplying the household, all but five of the participants, who depend on a spring, reported that they rely on a well. Participants who had a well were asked to provide an estimate of the well depth, if known. Of those participants indicating well depths, 70% reported depths of more than 50 feet, while 30% reported less than or equal to 50 feet. The maximum well depth reported was 600 feet; the average well depth was 146 feet. Sixteen percent of the wells were constructed in or prior to 1970. The earliest reported well construction date was 1893.

Household water systems were further identified with respect to the type of material used in the piping network for water distribution throughout the dwellings. The most widely used material was copper (48%), while plastic was reported by 42% of the participants. Nine percent of participants reported, "Don't know".

**Figure 1. Educational Level Achieved by Participants**

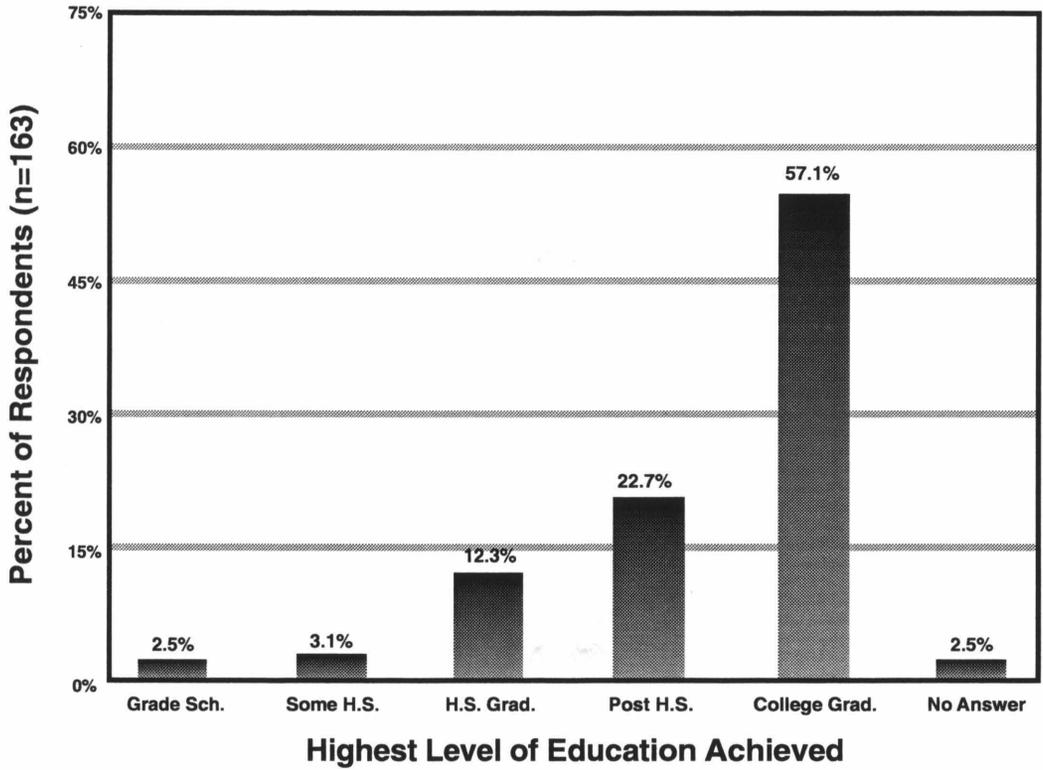


**Figure 2. Family Income of Participants**

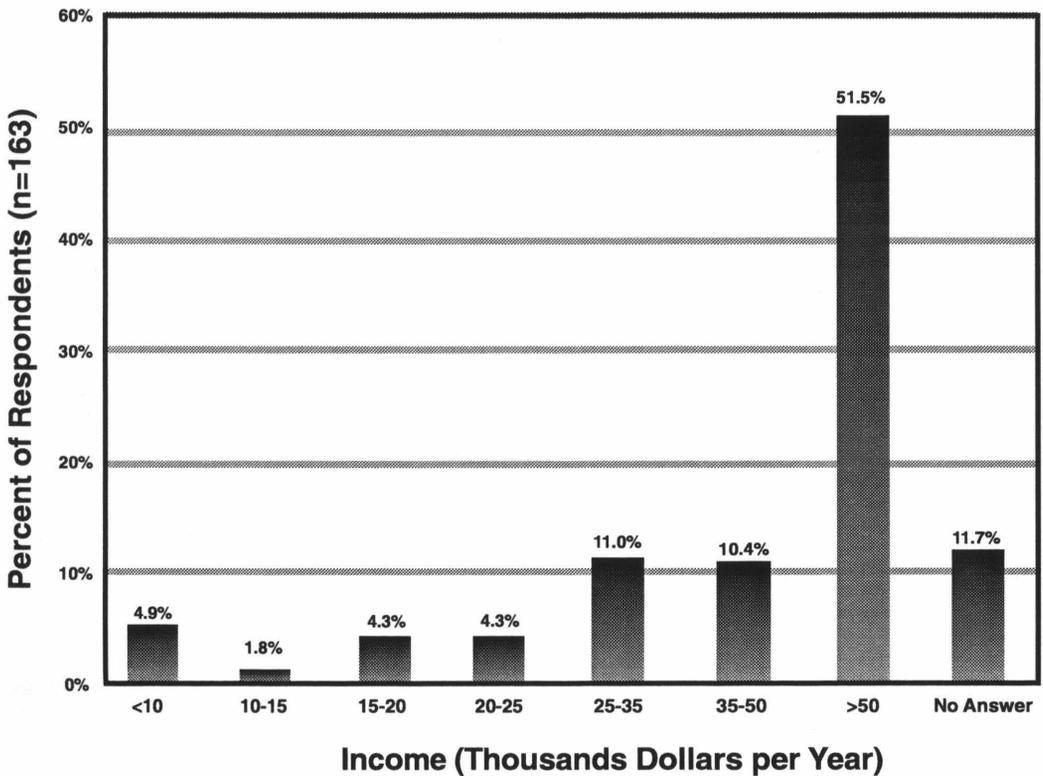

**Figure 3. Housing Environs of Participants**

## Housing Environs Distribution (N=379\*)

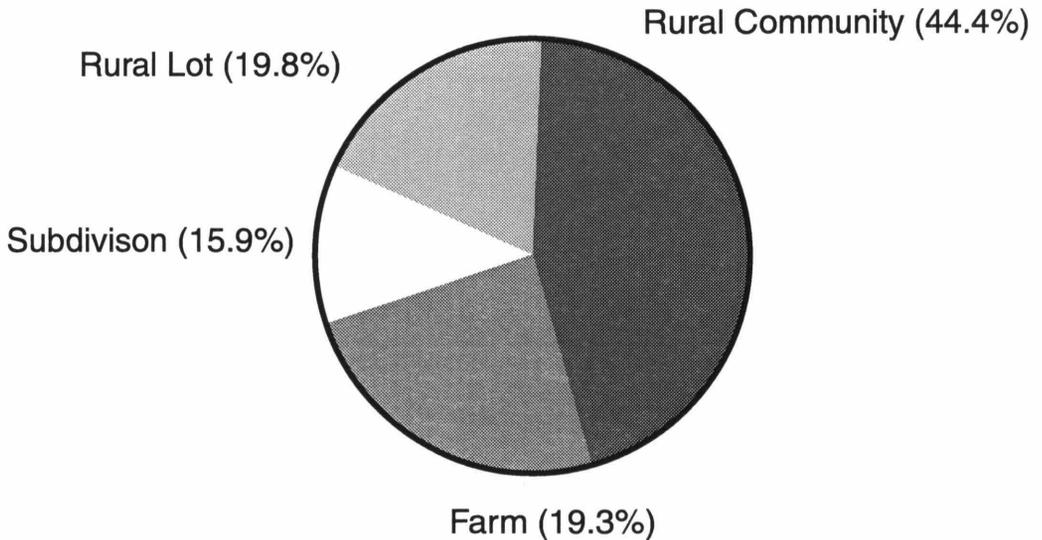

\* Four participants did not respond.

To properly evaluate the quality of water supplies in relation to the point of sampling, participants were asked if their household water systems had water treatment devices currently installed, and if so, the type of device. The results of the inquiry are presented in Figure 4. Twenty-eight percent of the participants reported at least one treatment device installed, with the most common type of treatment device in use being a sediment filter (66%).

### Participants' Perceptions of Household Water Quality

Participants were also asked about problems they were experiencing in their household water systems (see Appendix). They were asked initially whether or not they experienced one or more of the following conditions: (1) corrosion of pipes or plumbing fixtures; (2) unpleasant taste; (3) objectionable odor; (4) unnatural color or appearance; (5) floating, suspended, or settled particles in the water; and (6) staining of plumbing fixtures, cooking appliances/utensils or laundry. With the exception of (1) above, with which 15% of the participants identified, participants were given several more specific descriptions from which to choose if answering positively.

Sixteen percent of the participants responded that their water had an unpleasant taste. For these participants, the identification of tastes is presented in Figure 5. "Metallic" taste was the most common problem, identified by 45% of those who reported taste problems, followed by "bitter" at 28%. "Other" tastes, such as rusty, were identified by 10% of participants noting taste problems

An objectionable odor was reported by 9% of the participants. Of these, the description of odors selected is shown in Figure 6. The most prevalent odor described was "rotten egg", identified by 64% of those reporting odor problems, followed by "musty" at 19%. Eight percent indicated "other" including a description of swampy.

Twelve percent of the participants affirmed their water had an unnatural color or appearance. "Muddy" and "oily film" were identified by 40% and 17%, respectively, of those who reported appearance problems (Figure 7). Nine percent offered their own descriptions by selecting "other" to include blue-green.

A related question sought to identify the presence of solid particles in participants' water supplies. Seventeen percent described such a condition; almost half (46%) of these reported that they noticed "black specks" in their water (Figure 8). Seventeen percent indicated "other" including descriptions such as sand.

Staining problems were reported by 46% of the participants. As presented in Figure 9, the major problem was that of "blue-green" identified by 58% of those with staining problems, followed by "rusty" stains, reported by 43%.

## **Household Water Quality Analysis**

Ultimately, two sample groups resulted: the "tap water" and "raw water" samples. The "tap water" group consisted of the 383 individual household water supplies analyzed to represent the actual water quality at the drinking water tap (including treated water). The "raw water" group consisted of samples from untreated systems only - a total of 276 samples.

The raw water sample results presented below may not be entirely indicative of the status of raw groundwater quality in Louisa County. This may be particularly true for many of the nuisance contaminants, for which treatment systems have been installed since many of the already treated supplies likely represented the worst cases for specific contaminants correctable by treatment devices. Therefore, the inclusion of actual raw water (before treatment) analyses, if they had been available from those households with treatment devices installed, would likely have tended to worsen the overall assessment of Louisa County raw water quality.

## **General Water Chemistry Analysis**

The tests included in the general water chemistry analysis are listed in Table 1, along with the detection limits, where appropriate, for each test as determined by laboratory equipment and testing procedure constraints. Also presented are the averages and ranges for each sample group defined. Table 2 provides, for both sample groups, the percentage of constituent values exceeding a given water quality standard or guideline. The results and importance of each test for both of the sample groups are individually discussed below.

Iron. Iron in water does not usually present a health risk. It can, however, be very objectionable, if present in amounts greater than 0.3 mg/L. Excessive iron can leave brown-orange stains on plumbing fixtures and laundry. It may give water and/or beverages a bitter metallic taste and may also discolor beverages.

Seven percent of samples in the tap water group and 9% in the raw water sample group had iron concentrations exceeding the U.S. Environmental Protection Agency (EPA) Secondary Maximum Contaminant Level (SMCL) of 0.3 mg/L. This result was not surprising in view of the generally accepted notion that excessive iron is prevalent in rural water supplies throughout much of Virginia. Only 3% of all participants reported the installation of an iron removal filter, however, water softeners, which can remove small amounts of iron, as well as manganese, had been installed in 5% of the households. Despite the treatment equipment in place, the results of the sample questionnaire (see Appendix) revealed that 43% of the 176 who reported staining problems, or 20% of all participants, classified the color of those stains as “rusty” (red/orange/brown). Stains of this color on plumbing fixtures, cooking appliances/utensils, and/or laundry are usually attributed to excessive iron concentrations.

It should be noted that the SMCL for iron is likely based more on taste considerations than long-term staining tendencies, particularly on plumbing fixtures. It has been suggested that concentrations below 0.1 mg/L are preferred, when stain prevention is of concern. When a value of 0.1 mg/L was used as the threshold concentration, an additional 7% and 6% of samples in the tap water and raw water groups, respectively, exceeded this limit.

Manganese. Manganese does not present a health risk. However, if present in amounts greater than 0.05 mg/L, it may give water a bitter taste and produce black stains on laundry, cooking utensils, and plumbing fixtures.


The results of these analyses indicated that the extent of manganese problems in Louisa County may be similar to that of iron. While manganese stains are generally dark and 3% of all participants indicated “black” stains, 10% of the tap water and 11% of the raw water samples exceeded the SMCL for manganese of 0.05 mg/L. The “particles in water” description of “black specks”, also reported by 8% of all participants, may also provide evidence of excessive manganese concentrations.

Hardness. Hardness is a measure of calcium and magnesium in water. Hard water does not present a health risk. However, it keeps soap from lathering, decreases the cleaning action of soaps and detergents, and leaves soap “scum” on plumbing fixtures, and scale deposits in water pipes and hot water heaters. Softening treatment is highly recommended for very hard water (above 180 mg/L). Water with a hardness of about 60 mg/L or less does not need softening.


Hardness is an additional “natural” parameter usually linked to karst terrain and limestone formations that are not prevalent in Louisa County. Five percent of all participants had installed water softeners (Figure 4), however, little use of water softeners appears to be warranted, as only 1% of the tap water and raw water samples exceeded the maximum recommended hardness level of 180 mg/L.

Hardness tolerance, like that of many nuisance contaminants, is somewhat relative to individual preferences. For example, water with total hardness between 60 mg/L and 180 mg/L may warrant the installation of a commercial water softener in the view of some household water users while others are satisfied with untreated water. Seventeen percent of tap water and 14% of raw water samples were in the range of 60 mg/L to 180 mg/L total hardness, indicating that approximately one-sixth of all samples could be classified as “moderately hard” or harder.


**Figure 4. Household Water Treatment Devices Installed**

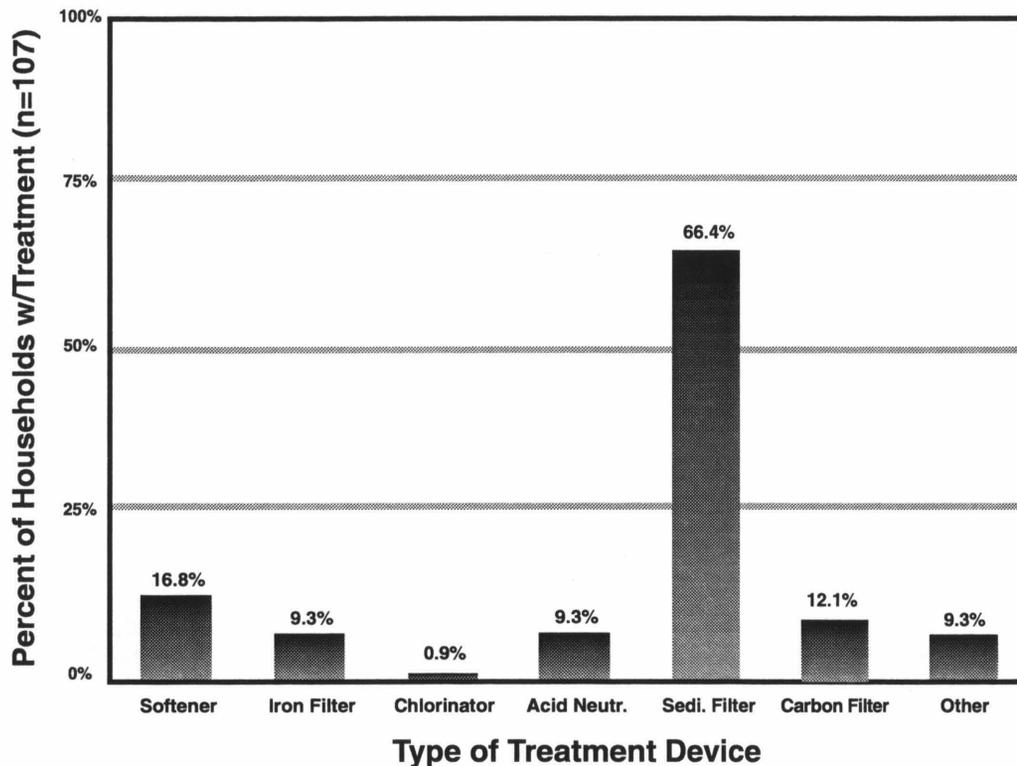


**Figure 5. Unpleasant Tastes Reported by Participants**

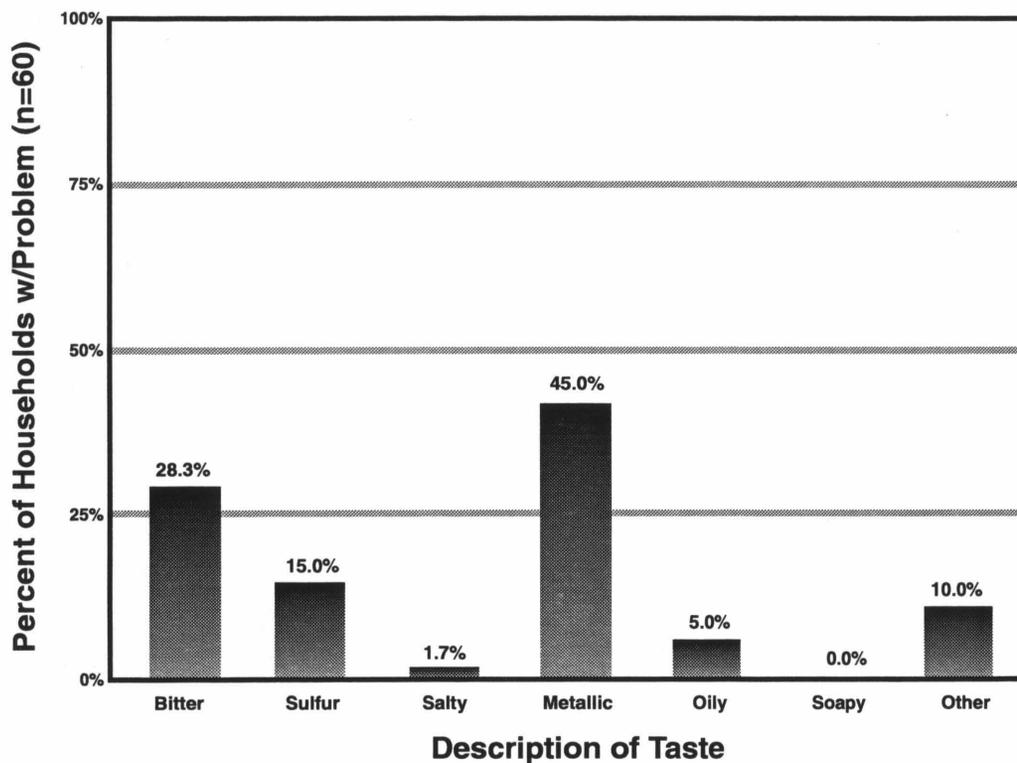


**Figure 6. Objectionable Odors Reported by Participants**

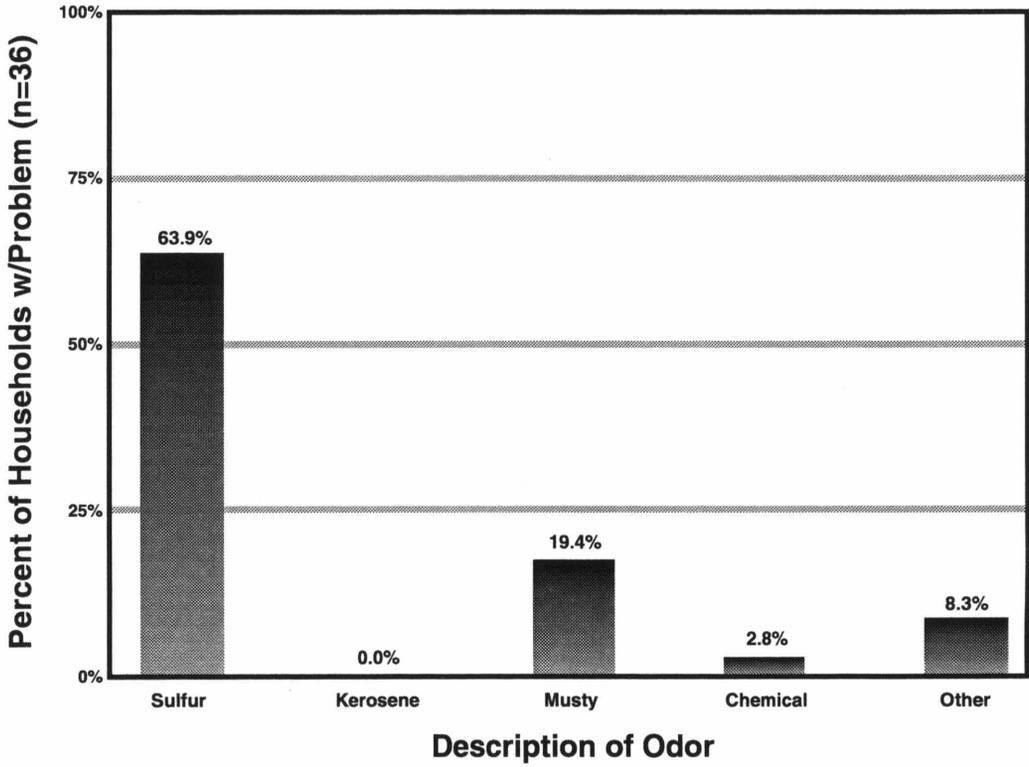


**Figure 7. Unnatural Appearance Reported by Participants**

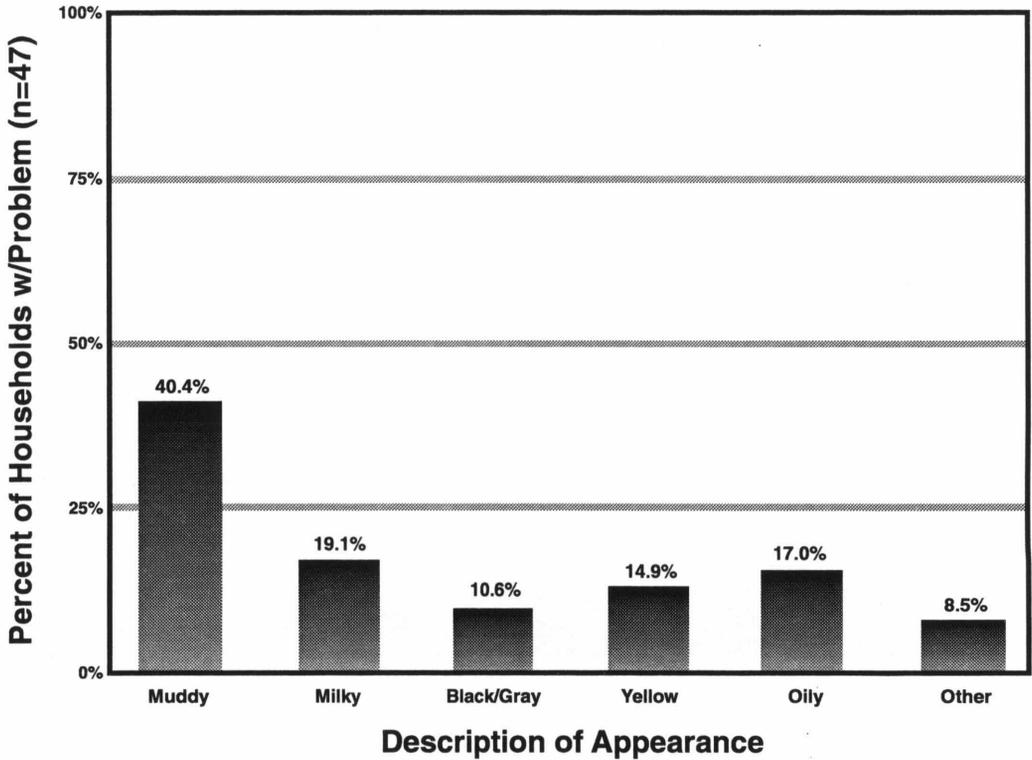

**Figure 8. Particles in Water Reported by Participants**

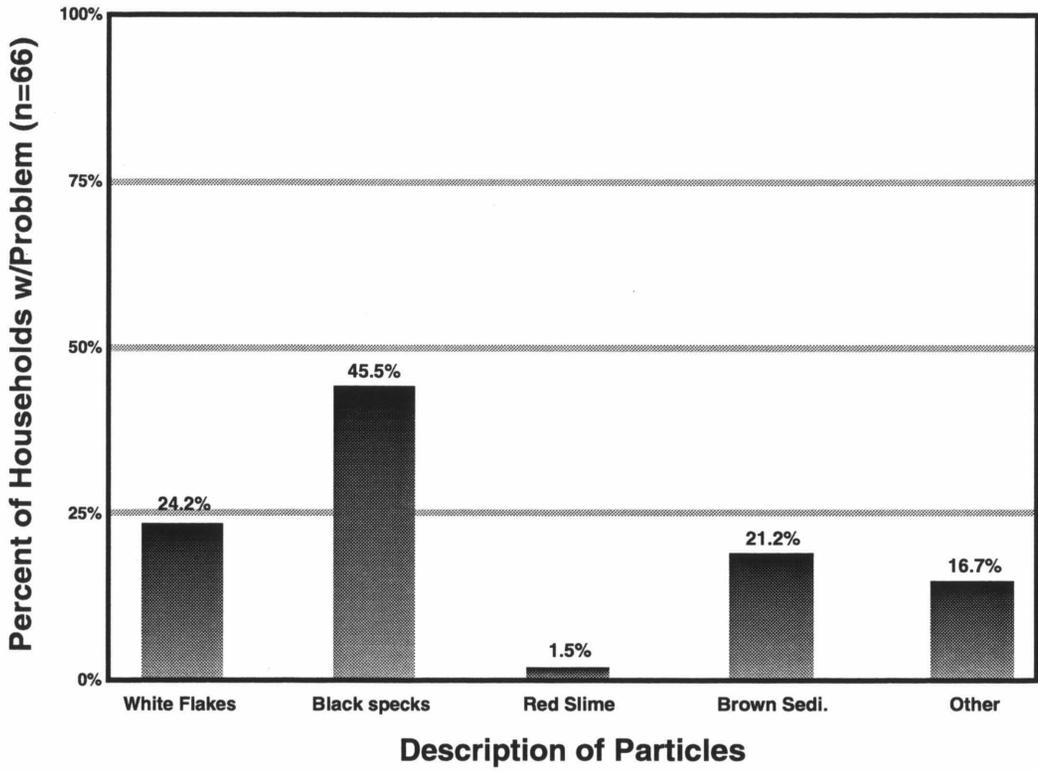

**Figure 9. Staining Problems Reported by Participants**

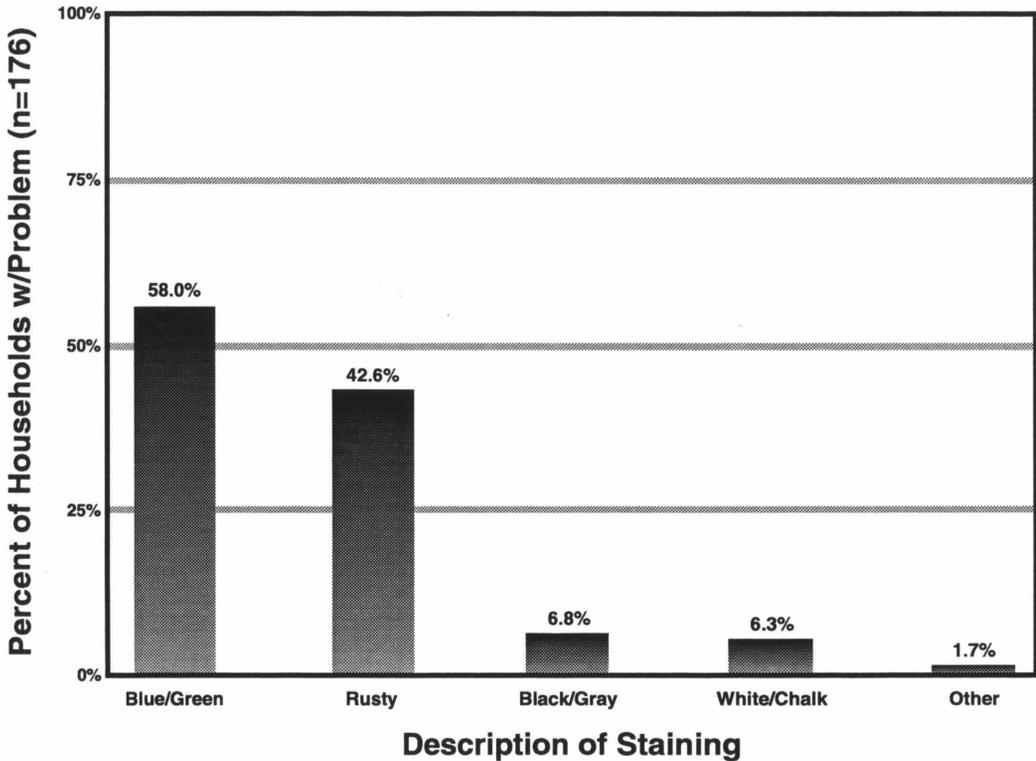

Sulfate. High sulfate concentrations may result in adverse taste or may cause a laxative effect. The SMCL for sulfate is 250 mg/L. Sulfates are generally naturally present in groundwater and may be associated with other sulfur-related problems, such as hydrogen sulfide gas. This gas may be caused by the action of sulfate-reducing bacteria, as well as by other types of bacteria (possibly disease-causing bacteria) on decaying organic matter. While it is difficult to test for the presence of this gas in water, it can be easily detected by its characteristic “rotten egg” odor, which may be more noticeable in hot water. Water containing this gas may also corrode iron and other metals in the water system, and may stain plumbing fixtures and cooking utensils.

Sulfate concentrations were relatively low for both the raw water and tap water sample groups. Only one of the raw water and tap water samples exceeded 250 mg/L. The complaints of a “rotten egg/sulfur” odor by nearly two-thirds of those reporting odor problems, indicate that hydrogen sulfide gas may be a problem in some household water systems in Louisa County; a conclusion that can not be confirmed by the presence of sulfate.

Chloride. Chloride in drinking water is not a health risk. Natural levels of chloride are generally low, and high levels in drinking water usually indicate contamination from a septic system, road salts, fertilizers, industry, or animal wastes. High levels of chloride may speed corrosion rates of metal pipes and cause pitting and darkening of stainless steel. The EPA has set an SMCL for chloride of 250 mg/L. One of the samples in the tap water and raw water sample groups reached the SMCL for chloride, however, none exceeded the standard.

Fluoride. Fluoride is of concern primarily from the standpoint of its effect on teeth and gums. Small concentrations of fluoride are considered to be beneficial in preventing tooth decay, whereas moderate amounts can cause brownish discoloration of teeth, and high fluoride concentrations can lead to tooth and bone damage. For these reasons, the EPA has set both a SMCL of 2 mg/L and a Maximum Contaminant Level (MCL) of 4 mg/L. None of the samples in either sample group exceeded the SMCL or the MCL for fluoride.

Total Dissolved Solids (TDS). High concentrations of dissolved solids may cause adverse taste effects and may also deteriorate household plumbing and appliances. The EPA SMCL is 500 mg/L total dissolved solids. Average TDS concentrations were 70 mg/L and 80 mg/L for the raw water and tap water sample groups, respectively. One of the raw water and two of the tap water samples exceeded the standard with a maximum TDS concentration of 608 mg/L.

pH. The pH indicates whether water is acidic or alkaline. Acidic water can cause corrosion in pipes and may cause toxic metals from the plumbing system to be dissolved in drinking water. The life of plumbing systems may be shortened due to corrosion, requiring expensive repair and replacement of water pipes and plumbing fixtures. Treatment is generally recommended for water with a pH below 6.5. Alkaline water with a pH above 8.5 is seldom found naturally and may indicate contamination by alkaline industrial wastes. The EPA has set a suggested range of between 6.5 and 8.5 on the pH scale for drinking water.

The average pH reading was 6.6 for the raw water and 6.7 for the tap water sample groups. None of the tap water or raw water samples exceeded a pH of 8.5. For the tap water and raw water sample groups, respectively, 37% and 45% of the measured pH values were less than 6.5. While the remaining samples had a pH above 6.5, slightly acidic water with a pH between 6.5 and 7.0 can lead to less immediate staining and corrosion problems. An additional 35% of both tap water and raw water samples fell into this category.

**Saturation Index.** The saturation index (Langlier) is used, in addition to pH, to evaluate the extent of potential corrosion of metal pipes, plumbing fixtures, etc. It is a calculated value based on the calcium concentration, total dissolved solids concentration, measured pH, and alkalinity. A saturation index greater than zero indicates that protective calcium carbonate deposits may readily form on pipe walls. A saturation index less than zero indicates that the water does not have scale-forming properties and pipes may be subject to corrosion. Saturation index values between -1 and +1 are considered acceptable for household water supplies.

No saturation index values were determined to be above +1 in either sample group. Values of less than -1, however, were determined for 92% of the tap water and 95% of the raw water samples. Average saturation index values were -2.73 and -2.90 for the tap water and raw water sample groups, respectively, with a minimum value of -5.69 for both groups.

**Copper.** The EPA health standard for copper in public drinking water supplies is 1.3 mg/L, the maximum level recommended to protect people from acute gastrointestinal illness. Even lower levels of dissolved copper may give water a bitter or metallic taste and produce blue-green stains on plumbing fixtures. Consequently, EPA has established an SMCL for copper of 1.0 mg/L in household water.

Three percent of the tap water and 5% of the raw water samples exceeded the SMCL of 1.0 mg/L, with the majority of these samples exceeding the recommended health level of 1.3 mg/L (2% of the tap water and 3% of the raw water samples). The maximum measured copper concentration was 7.25 mg/L in both cases. Since natural levels of copper in groundwater are low, and the primary contributor of copper in drinking water is corrosion of copper water pipes and fittings, low copper levels were expected, even in the case of tap water samples, assuming that water lines were flushed properly prior to sampling.

**Sodium.** Sodium may be a health hazard to people suffering from high blood pressure or cardiovascular or kidney diseases. For those on low-sodium diets, 20 mg/L is suggested as a maximum level for sodium in drinking water, although a physician should be consulted in individual cases. Average sodium concentrations were 8.2 mg/L and 5.9 mg/L for the tap water and raw water sample groups, respectively, while the maximum concentrations were 154 mg/L for the former and 53 mg/L for the latter group. For the tap water samples, 6% of the samples exceeded 20 mg/L, while only 3% of the raw water samples exceeded 20 mg/L.

It should be reemphasized, however, that the suggested threshold of 20 mg/L for sodium is relatively low and applicable only to individuals suffering from health problems, such as heart disease or high blood pressure. To evaluate the presence of high sodium levels in the context of an otherwise healthy individual, a threshold value of 100 mg/L sodium has been suggested. The maximum tap water sample concentration presented above represented the only sample that exceeded this value.

**Nitrate.** High levels of nitrate may cause methemoglobinemia or “blue-baby” disease in infants. Though the EPA has set a MCL for nitrate (as N) of 10 mg/L, it suggests that water with greater than 1 mg/L not be used for feeding infants. Levels of 3 mg/L or higher may indicate excessive contamination of the water supply by commercial fertilizers and/or organic wastes from septic systems or farm animal operations, which may be subject to seasonal and climatic influences.

**Table 1. Average and range of concentration of contaminants comprising general water chemistry analysis for Louisa County.**

| Test             | Detection Limit | Measured Concentrations |                 |        |                   |       |        |
|------------------|-----------------|-------------------------|-----------------|--------|-------------------|-------|--------|
|                  |                 | Raw Water (n=276)       |                 |        | Tap Water (n=383) |       |        |
|                  |                 | Avg. <sup>1</sup>       | Min.            | Max.   | Avg.              | Min.  | Max.   |
| Iron (mg/L)      | 0.005           | 0.123                   | DL <sup>2</sup> | 3.890  | 0.104             | DL    | 3.890  |
| Manganese (mg/L) | 0.001           | 0.024                   | DL              | 0.548  | 0.022             | DL    | 0.548  |
| Hardness (mg/L)  | 0.3             | 34.5                    | DL              | 465.0  | 37.1              | DL    | 465.0  |
| Sulfate (mg/L)   | 0.3             | 4.0                     | DL              | 313.7  | 4.8               | DL    | 313.7  |
| Chloride (mg/L)  | 40.0            | 43.0                    | 250.0           | 250.0  | 44.0              | DL    | 250.0  |
| Fluoride (mg/L)  | 0.5             | 0.50                    | DL              | 1.08   | 0.51              | DL    | 1.23   |
| TDS (mg/L)       | 1.0             | 70.0                    | 10.0            | 608.0  | 80.0              | 10.0  | 608.0  |
| pH               | -               | 6.59                    | 5.02            | 7.80   | 6.69              | 5.02  | 8.05   |
| Saturation Index | -               | -2.90                   | -5.69           | -0.16  | -2.73             | -5.69 | -0.16  |
| Copper (mg/L)    | 0.002           | 0.214                   | DL              | 7.254  | 0.189             | DL    | 7.254  |
| Sodium (mg/L)    | 0.01            | 5.88                    | 0.59            | 52.50  | 8.23              | 0.19  | 154.20 |
| Nitrate (mg/L)   | 0.005           | 1.419                   | DL              | 55.351 | 1.291             | DL    | 55.351 |

<sup>1</sup>Averages calculated on the basis of below detection limit (DL) values set equal to the DL.

<sup>2</sup>Sample concentration non-detectable, i.e., below the detection limit for the given contaminant.

**Table 2. Percent of concentrations exceeding established standards for contaminants comprising general water chemistry and bacteriological analysis for Louisa County.**

| Test                    | Standard          | Percent of Values Exceeding Standard |                   |
|-------------------------|-------------------|--------------------------------------|-------------------|
|                         |                   | Raw Water (n=276)                    | Tap Water (n=383) |
| Iron (mg/L)             | 0.3               | 8.7                                  | 7.0               |
| Manganese (mg/L)        | 0.05              | 10.5                                 | 10.4              |
| Hardness (mg/L)         | 180.0             | 1.1                                  | 1.3               |
| Sulfate (mg/L)          | 250.0             | 0.4                                  | 0.3               |
| Chloride (mg/L)         | 250.0             | 0                                    | 0                 |
| Fluoride (mg/L)         | $\frac{2}{4}$     | $\frac{0}{0}$                        | $\frac{0}{0}$     |
| TDS (mg/L)              | 500.0             | 0.4                                  | 0.5               |
| pH - Low                | 6.5               | 44.6                                 | 37.1              |
| pH - High               | 8.5               | 0                                    | 0                 |
| Saturation Index - Low  | -1.0              | 95.3                                 | 92.2              |
| Saturation Index - High | +1.0              | 0                                    | 0                 |
| Copper (mg/L)           | $\frac{1.0}{1.3}$ | $\frac{4.7}{3.3}$                    | $\frac{3.3}{2.3}$ |
| Sodium (mg/L)           | 20.0              | 2.9                                  | 6.3               |
| Nitrate (mg/L)          | 10.0              | 1.8                                  | 1.6               |
| Total Coliform          | ABSENT            | 60.1                                 | 51.7              |
| E. coli                 | ABSENT            | 10.1                                 | 7.8               |

The maximum concentration of nitrate obtained was 55.4 mg/L for both the tap water and raw water sample groups. Two percent of samples in both sample groups exceeded the MCL of 10 mg/L. Thus, serious nitrate contamination does not appear to be a widespread problem in Louisa County. When a 1 mg/L threshold value was selected, however, a much higher occurrence of nitrate was determined. In this case, more than a quarter of the samples, 27% of the tap water and 28% of the raw water samples, exceeded the level of potential concern to infant health. Furthermore, 10% of the tap water samples and 11% of the raw water samples had nitrate concentrations exceeding 3 mg/L, indicating that health-impacting levels would likely be approached in a number of cases.

## **Bacteriological Analysis**

A common hazard of private household water supplies is contamination by potentially harmful bacteria and other microorganisms. Microbiological contamination of drinking water can cause short-term gastrointestinal disorders, such as cramps and diarrhea that may be mild to very severe. Of the non-gastrointestinal disorders, one particularly important disease transmissible through drinking water is Viral Hepatitis A. Other diseases include salmonella infections, dysentery, typhoid fever, and cholera.

Coliform bacterial detection is simply an indication of the possible presence of pathogenic, or disease-causing organisms. Detection of coliform bacteria is confirmed by a total coliform analysis result above zero. Coliforms are always present in the digestive systems of all warm-blooded animals and can be found in their wastes. Coliforms are also present in the soil and in plant material. While a water sample with total coliform bacteria present may have been inadvertently contaminated during sampling, other possibilities include surface water contamination due to include poor well construction, contamination of the household plumbing system, or water table contamination. To determine whether or not the bacteria were from human and/or animal waste, positive total coliform tests were followed up by an analysis for *E. coli* bacteria.

Of the 383 Louisa County household water samples analyzed for total coliform bacteria, 198 (52%) tested positive (present). Subsequent *E. coli* analysis for these total coliform positive samples resulted in 30, or 15%, positive results, or 8% of all household water samples undergoing bacteriological analysis. The percentages of positive total coliform and *E. coli* results for the raw water sample group were 60 and 10, respectively.

The susceptibility of household water supplies to bacteriological contamination has often been associated with the type of water source. For example, it is generally accepted that the likelihood of bacteriological contamination of springs is greater than that of well water supplies, which usually offer better protection from surface, or near surface, contaminants. Similarly, deep drilled wells are better protected than shallow dug and bored wells. This contention is clearly borne out by the results of this program, which indicated that the incidence of total coliform and *E. coli* contamination of dug/bored wells was 86% and 17%, respectively, while for drilled wells, positive total coliform and *E. coli* results were obtained for 34% and 4% of the samples. (For the limited spring water supply sample of five, total coliform bacteria were detected in three samples and one sample had *E. coli* bacteria present).

The age of a water source/system is an additional factor which may have an influence on contamination susceptibility. With respect to wells in particular, deterioration of the well structure over time, cumulative damage caused by equipment traffic, etc., and prolonged exposure of the wellhead area to potentially harmful pollutants may all contribute to the

**Table 3. Measures taken or planned by respondents, since water quality analysis, to improve water supply (Louisa County)**

| Measure  | Percent of All Respondents (n=163) | Percent of Respondents who Reported the Following Problems |                      |                          |             |
|--|------------------------------------|--|----------------------|--------------------------|-------------|
|  |                                    | Health Only (n=34)   | Nuisance Only (n=32) | Health & Nuisance (n=33) | None (n=64) |
| Contact an Agency, such as the Health Department       | 11.7                               | 17.6   | 6.3                  | 24.2                     | 4.7         |
| Seek Additional Water Testing from Another Lab         | 3.7                                | 2.9  | 3.1                  | 6.1                      | 3.1         |
| Determine Source of Undesirable Condition              | 6.1                                | 5.9  | 0                    | 12.1                     | 6.3         |
| Pump Out Septic System                                 | 16.6                               | 8.8  | 15.6                 | 18.2                     | 20.3        |
| Improve Physical Condition of Water Source             | 3.7                                | 2.9  | 0                    | 12.1                     | 1.6         |
| Shock-Chlorinate Water System                          | 22.1                               | 50.0   | 0                    | 54.5                     | 1.6         |
| Obtain New Water Source                                | 1.8                                | 0  | 0                    | 6.1                      | 1.6         |
| Use Bottled Water for Drinking/Cooking                 | 6.7                                | 5.9  | 6.3                  | 15.2                     | 3.1         |
| Temporary Disinfection, such as Boiling Water          | 1.8                                | 8.8  | 0                    | 0                        | 0           |
| Purchase or Rent Water Treatment Equipment             | 11.0                               | 0  | 28.1                 | 12.1                     | 7.8         |
| Improve Existing Water Treatment Equipment             | 3.1                                | 2.9  | 9.4                  | 0                        | 1.6         |
| Take Other Measures to Eliminate/Reduce Contaminant(s) | 3.1                                | 0  | 0                    | 9.1                      | 3.1         |
| Have Not Done Anything                                 | 41.1                               | 23.5   | 43.8                 | 6.1                      | 67.2        |

eventual contamination of the well. A major age-related impact could relate to the development of, and conformance with, well construction standards through the years. Major legislation in Virginia, to address such issues, has been enacted in recent years, most notably in the early 1970's and early 1990's. Therefore, for the purpose of examining the occurrence of bacteriological contamination with well age, the sample results were evaluated for the following three construction date categories: (1) pre-1970, (2) 1970-1989, and (3) 1990 to date. With respect to total coliform bacteria, for each of the above categories, the percentages of well water samples determined to be positive were as follows: (1) 69, (2) 58, and (3) 29. For *E. coli* bacteria, the corresponding percentages were (1) 16, (2) 8, and (3) 2. Perhaps not surprisingly, a substantial reduction in positive bacteria cases overall was not noted until the latter time period, likely influenced not only by the newness of the wells, but also the substantiality of the most recent legislation, requiring stricter well standards, licensing of well drillers, and post-construction inspections.

Fecal bacteria present in household water supplies may have originated from animal waste generation or human waste from septic systems. Although, positive results should be viewed with concern, they are not a cause for panic. Individuals have probably been drinking this water for some time with no ill effects and could possibly continue to do so. Nevertheless, such problems should be further investigated and remedied, if possible. Program participants whose water tested positive were given information regarding emergency disinfection, well improvements, septic system maintenance and other steps to correct the source of contamination. After taking initial corrective measures, they were advised to have the water retested for total coliform, followed by *E. coli* tests, if warranted.

## **Post-Program Survey**

Following the completion of the basic educational program, a survey form (see Appendix) was mailed to the 383 households whose water supply had been tested. The objectives of the survey were to determine: 1) reasons for program participation and for having water tested, and 2) what the respondents had done to correct water quality problems as a result of participation in the educational program. One hundred sixty-three participants (43%) returned the survey forms by the deadline.

## **Household Water Testing History**

Participants were asked to indicate their previous experience with water testing and, specifically, if and when they had last had a laboratory analysis of their present household water supply. Forty-two percent of the respondents indicated that they had previously obtained water test results. Of those reporting a prior testing date, 55% had done so within the past five years and 30% within the past two years.

## **Reasons for Program Participation**

People participated in the water quality program for one or more reasons. Seventy-eight percent of the respondents were prompted to participate by concern about the safety of their water supply. Thirty-four percent of the respondents were prompted by nuisance problems, such as staining, objectionable taste, and odor, etc. Thirteen percent wanted to follow up on previous tests of their household water. Seventeen percent cited other reasons, such as general curiosity and low-cost opportunity.

## Follow-up Activities Taken or Planned

Participants were asked to indicate the measures they planned to take, or had already taken, to improve the quality of their water supply, since receiving the results of their water quality analysis. Table 3 presents the results of this inquiry, with the greatest number of households (11% or more) indicating one or more of the following actions: shock chlorinate the water system, pump out septic tank, contact a state agency for additional assistance, and purchase or rent water treatment equipment.

Participants were asked if the water analysis showed that their water was unsatisfactory for one or more of the following: bacteria, nitrate, sodium, iron, manganese, hardness, and pH. Responses were grouped in four categories: 1) households with potential health problems (positive coliform test results and/or unsatisfactory levels of nitrate or sodium in their water samples), 2) households with unsatisfactory levels of nuisance contaminants (one or more of the following: iron, manganese, hardness, and pH), 3) households with potential health problems and unsatisfactory levels of nuisance contaminants, and 4) households with neither potential health problems nor unsatisfactory levels of nuisance contaminants.

The measures planned or already taken to improve household water as follow-up to the water quality analysis were generally in agreement with the water quality problems identified by the testing. Of the households with potential health problems only and those with health problems in combination with unsatisfactory levels of nuisance contaminants, 85% had taken, or planned to take, at least one measure to improve their water supply. The measure taken by the greatest number of households in these two categories was: shock chlorinate the water system.

Respondents were only slightly more likely to address health-related problems than nuisance problems. Of the households with unsatisfactory levels of one or more nuisance contaminants and those with nuisance problems in combination with potential health problems only, 75% had taken, or planned to take, at least one measure to improve their water supply. Not unexpectedly, the group of households that reported the fewest follow-up measures (33%) were the households with neither potential health problems nor unsatisfactory levels of nuisance contaminants.

## CONCLUSIONS

---

The Louisa County Household Water Quality Educational Program was considered to be successful. The opportunity to participate in the program was well-received by Louisa County residents. Individuals participated in the program primarily because of concern about the safety of their water supply. Despite being a voluntary program, a somewhat geographically distributed sample, representing diverse household and water supply characteristics was obtained. While the project was designed for voluntary participation and quality control in sampling was not assured, the type of information gathered and summarized was, nevertheless, deemed useful for water quality assessment at county and regional levels.

Water quality analysis, for many nuisance constituents, generally supported the participants' descriptions of their water supplies regarding such problems as staining, taste and odor, and appearance. The severity of these symptoms is confirmed by the high incidence of water treatment devices installed -- 28% of all households participating had one or more water treatment devices installed.

Considering the results for both the raw and tap water sample groups, and the influence of water treatment devices, the major remaining household water quality problems in Louisa County, existing from a nuisance standpoint, were iron/manganese and corrosivity. The major health-related concerns were corrosivity (because of the potential to raise dissolved copper and levels in water) and bacteria. Fifty-two percent of the samples tested positive for total coliform and 8% were positive for *E. coli* bacteria. In these positive cases, participants were advised of ways to improve water supply conditions and were encouraged to pursue retesting for coliform bacteria.

Seventy-six percent of the households that reported having at least one water quality problem had taken, or planned to take, at least one measure to improve the quality of their water supply. Eleven percent or more of all respondents had taken, or planned to take, one of the following actions: shock chlorinate the water system, pump out septic tank, contact a state agency for additional assistance, and purchase or rent water treatment equipment.

## REFERENCES

---

- George, C.A. and J.L. Gray. 1988. *Water for Tomorrow - A Report on Water and Conservation Needs in Virginia*. Roanoke, Virginia: Virginia Water Project, Inc.
- Koebel, C.T., M.S. Cavell, and W.L. Morgan. 1993. *The Virginia Housing Atlas: Housing Trends and Patterns to 1990*. Blacksburg, Virginia: VPI&SU, Virginia Center for Housing Research.
- Ross, B. B., J. E. Woodard, T. A. Dillaha, E. B. Orndorff, J. R. Hunnings, and K. M. Hanna. 1991. *Evaluating Household Water Quality in Warren County, Virginia*. Information Series 91-1 (Household Water Quality Series 1). Blacksburg, Virginia: VPI&SU, College of Agriculture and Life Sciences.
- USEPA. 1979. *Methods for Chemical Analysis of Water and Wastes*. Report No. EPA 600/4-79-020. Washington, D.C.: U.S. Environmental Protection Agency.

# APPENDIX

---

- (1) Program Fact Sheet
- (2) Sample Identification and Questionnaire Form
- (3) Sample Water Quality Analysis Report
- (4) Report Interpretation
- (5) Post-Program Survey



### Virginia Cooperative Extension

Louisa County Office  
1 Woolfolk Ave.  
PO Box 399  
Louisa, Virginia 23093  
(540)967-3422 Fax (540)967-3489  
Email: ex109@vt.edu



*James E. Riddell*  
James E. Riddell, Extension Agent



# Louisa County HOUSEHOLD WATER TESTING PROGRAM

## WHAT WILL WE TEST FOR?

- |                        |                 |                    |           |
|------------------------|-----------------|--------------------|-----------|
| Nitrate                | Chloride        | Fluoride           | Sulfate   |
| Iron                   | Sodium          | Copper             | Manganese |
| PH (acidity)           | Corrosion Index | Hardness (Ca & Mg) |           |
| Total Dissolved Solids |                 |                    |           |

Bacteria (Total coliform & E.Coli Test)



**COST:** \$15.00 covers all the tests for those who have pre-registered. This same test would cost you \$150 if done commercially. Low-income residents may qualify for testing at no charge.

### SUPPORT FUNDING FOR THIS PROJECT:

- Virginia Cooperative Extension, Louisa County
- Chesapeake Bay Foundation



**ALL RESULTS ARE CONFIDENTIAL**

**FOR MORE INFORMATION, PRE-REGISTRATION FORMS, OR FINANCIAL ASSISTANCE APPLICATIONS CALL:**

540/967-3422 or from Goochland-556-3732, Palmyra-589-3093, Richmond-648-4115, Charlottesville-979-0479

*Land-Grant Universities—The Commonwealth Is Our Campus*  
Extension is a joint program of Virginia Tech, Virginia State University, the U.S. Department of Agriculture, and state and local governments.

Virginia Cooperative Extension programs and employment are open to all, regardless of race, color, religion, sex, age, veteran status, national origin, disability, or political affiliation. An equal opportunity/affirmative action employer.

**SCHEDULED INFORMATIONAL MEETINGS:**

(pre-register for the date most convenient for you) - (first-come, first-served basis)

- May 24<sup>th</sup> – Holly Grove Ruitan Center - 7:00 PM
- May 25<sup>th</sup> – Louisa County Administration Building 7:00 PM

- \* Learn why and how to take water samples.
- \* Water Quality Publications available.
- \* Pick up sample kits.

**SCHEDULED WATER SAMPLE COLLECTION DATES:**

- June 1<sup>st</sup> – Water Sample Collection at Holly Grove for May 24<sup>th</sup> Participants – 6:00 AM – 1:00 PM
- June 15<sup>th</sup> – Water Sample Collection at Louisa Co. Office Meeting Room for May 25<sup>th</sup> Participants – 6:00 AM – 1:00 PM

**SCHEDULED TEST RESULTS MEETING:**

- June 28<sup>th</sup> – Test results reviewed for Holly Grove Collections – 7:00 PM
- July 8<sup>th</sup> – Test results reviewed for Louisa County Office Collection – 7:00 PM

- \* Receive test results and what they mean
- \* Specialists will be available to recommend treatments or protection strategies.

**REGISTRATION FORM  
HOUSEHOLD WATER TESTING PROGRAM**

NAME: \_\_\_\_\_

ADDRESS: \_\_\_\_\_ CITY STATE ZIP

DAY TIME PHONE: (\_\_\_\_) \_\_\_\_ - \_\_\_\_\_

**(Choose only one meeting to attend)**

\_\_\_\_\_ I would like to attend the meeting in Holly Grove on May 24<sup>th</sup> at 7:00 PM

\_\_\_\_\_ I would like to attend the meeting in Louisa on May 25<sup>th</sup> at 7:00 PM

\_\_\_\_\_ I have enclosed the application for free water testing

Return this portion with your free water testing application to: Virginia Cooperative Extension, PO Box 399, Louisa, VA 23093

If you are a person with a disability and require any auxiliary aids, services, or other accommodations, please discuss your needs with the Extension Office within 5 days prior to the event.

(2) Sample Identification and Questionnaire Form

LOUISA COUNTY HOUSEHOLD WATER QUALITY PROGRAM

Louisa County Cooperative Extension
1 Woolfolk Ave. Co. Adm. Bldg.
P.O. Box 399
Louisa, VA 23093-0399
(540) 967-3422

SAMPLE IDENTIFICATION (Please print clearly and provide complete information on both sides of form.)

Sample No.: \_\_\_\_\_ Date collected: \_\_\_\_\_

Sample submitted by:

Name: \_\_\_\_\_

Mailing address: \_\_\_\_\_

Telephone: \_\_\_\_\_

FOR OFFICE USE ONLY
Map Grid No. \_\_\_\_\_
Lab Sample No. \_\_\_\_\_

Household water supply source drawn for sample (check one):

\_\_\_ well \_\_\_ spring \_\_\_ cistern \_\_\_ other (Specify: \_\_\_\_\_)

If well is checked above: (a) is it a \_\_\_ dug or bored well, \_\_\_ drilled well, \_\_\_ don't know;

(b) what is its approximate depth, if known? \_\_\_\_\_ feet

(c) what year was well constructed, if known? \_\_\_\_\_

Do other households share the same water supply? \_\_\_ yes \_\_\_ no If yes, approximately how many? \_\_\_\_\_

Water treatment devices currently installed and affecting cold water only drawn at faucet for sample (check all that apply):

\_\_\_ none

\_\_\_ acid water neutralizer

\_\_\_ water softener (conditioner)

\_\_\_ sediment filter (screen or sand type)

\_\_\_ iron removal filter

\_\_\_ activated carbon (charcoal) filter

\_\_\_ automatic chlorinator

\_\_\_ other (specify: \_\_\_\_\_)

SAMPLING INSTRUCTIONS: You must take your water samples only on the collection day you have been assigned. For the general water analysis sample, use the larger plastic bottle as described below. A separate, smaller bottle is provided for bacteriological samples which should be taken last. If you have any questions about sampling procedures, call the Extension Office at (540) 967-3422.

- 1. Do not remove caps from sample bottles until you are ready to take each sample. Do not touch inside of cap or mouth of either bottle.
2. Turn on the cold water faucet in the kitchen or bathroom (select a stationary, non-swivel faucet, if possible) and allow the water to run until it becomes as cold as it will get; then let it run for one more minute.
3. Slowly and carefully fill the larger bottle to avoid splashing or overflowing. Pour out this rinse water and then refill bottle completely. Tighten cap on bottle securely.
4. Let the water run for an additional two or three minutes. Reduce flow to prevent splashing and carefully fill the smaller bottle only once to the shoulder (just below the threaded top). DO NOT RINSE BOTTLE. Replace cap tightly.
5. Do not write anything on the bottle labels. If samples are not to be delivered immediately, store in refrigerator or on ice until ready to deliver later that day.
6. Fill out this Sample Identification Form and Questionnaire (on reverse side) completely and bring it, along with both water sample bottles, to the designated collection site on your assigned collection day.

# Sample Identification and Questionnaire Form (cont.)

**QUESTIONNAIRE** (Please answer the following questions as completely as possible, considering how you view the **present** condition of the water sampled, including improvements due to any treatment devices identified on other side of form.)

1. Describe the location of your home. (Check one)  
 on a farm     on a remote, rural lot     in a rural community     in a housing subdivision
2. What pipe material is primarily used throughout your house for water distribution? (Check one)  
 copper     lead     galvanized steel     plastic (PVC, PE, etc.)     other (specify: \_\_\_\_\_)     don't know
3. Do you have problems with corrosion or pitting of pipes or plumbing fixtures?     yes     no
4. Does your water have an unpleasant taste?     yes     no
5. If yes, how would you describe the taste? (Check all that apply)  
 bitter     sulfur     salty     metallic     oily     soapy     other (specify: \_\_\_\_\_)
6. Does your water have an objectionable odor?     yes     no
7. If yes, how would you describe the odor? (Check all that apply)  
 "rotten egg" or sulfur     kerosene     musty     chemical     other (specify: \_\_\_\_\_)
8. Does your water have an unnatural color or appearance?     yes     no
9. If yes, how would you describe the color or appearance? (Check all that apply)  
 muddy     milky     black/gray tint     yellow tint     oily film     other (specify: \_\_\_\_\_)
10. Do you have problems with staining of plumbing fixtures, cooking appliances/utensils, or laundry?     yes     no
11. If yes, how would you describe the color of stains? (Check all that apply)  
 blue-green     rusty (red/orange/brown)     black or gray     white or chalk     other (specify: \_\_\_\_\_)
12. In a standing glass of water, do you notice floating, suspended, or settled particles?     yes     no
13. If yes, how would you describe this material? (Check all that apply)  
 white flakes     black specks     reddish-orange slime     brown sediment     other (specify: \_\_\_\_\_)
14. If your water supply is located **100 feet or less** from any of the following, please indicate. (Check all that apply)  
 septic system drain field     home heating oil storage tank (above or below ground)  
 pit privy or outhouse     stream, pond, or lake  
 cemetery     compost/trash pile
15. If your water supply is located **½ mile or closer** to any of the following, please indicate. (Check all that apply)  
 landfill     golf course  
 illegal dump     field crop/plant production  
 active quarry     farm animal operation  
 abandoned quarry, industry, etc.     manufacturing/processing operation (specify: \_\_\_\_\_)  
 commercial underground storage tank or supply lines (gasoline service station, heating oil supplier, etc.)

This material is based upon work supported by the U.S. Department of Agriculture, Extension Service.

*Land-Grant Universities — The Commonwealth Is Our Campus*  
Extension is a joint program of Virginia Tech, Virginia State University, the U.S. Department of Agriculture, and state and local governments.

Virginia Cooperative Extension programs and employment are open to all, regardless of race, color, religion, sex, age, veteran status, national origin, disability, or political affiliation. An equal opportunity/affirmative action employer.

(3) Sample Water Quality Analysis Report

Louisa County  
Household Water Quality Program

Louisa County Cooperative Extension  
P.O. Box 399  
Louisa, VA 23093  
(540) 967-3422

Sample No: L

Louisa, VA 23093  
(540) 894-

Source: Drilled Well

None

Treatment:

Water Quality Results  
Date of Sample: 6/1/99

| Test                          | Household<br>Water Sample | Maximum Recommended<br>Level or Range |
|-------------------------------|---------------------------|---------------------------------------|
| Iron (mg/l)                   | 0.5607**                  | 0.3                                   |
| Manganese (mg/l)              | 0.1263**                  | 0.05                                  |
| Hardness (mg/l)               | 95.8                      | 180                                   |
| Sulfate (mg/l)                | 12.435                    | 250                                   |
| Chloride (mg/l)               | < 40                      | 250                                   |
| Fluoride (mg/l)               | < 0.5                     | 2                                     |
| Total Dissolved Solids (mg/l) | 145                       | 500                                   |
| pH                            | 7.3                       | 6.5 to 8.5                            |
| Saturation Index              | -1.07**                   | -1 to 1                               |
| Copper (mg/l)                 | 0.002                     | 1.0                                   |
| Sodium (mg/l)                 | 5.86                      | 20                                    |
| Nitrate-N (mg/l)              | 0.021                     | 10                                    |
| Total Coliform Bacteria       | PRESENT**                 | ABSENT                                |
| E. Coli Bacteri               | ABSENT                    | ABSENT                                |

\*\* Measured Value exceeds recommendation for household water.

Analysis coordinated by Water Quality Laboratory, Dept. of Biological Systems Engineering, Virginia Tech, Blacksburg, VA.

The information provided is for the exclusive use of the homeowner and should not be used as official documentation of water quality. The material is based upon work supported by the U.S. Department of Agriculture, Extension Service.

Land-Grant Universities - The Commonwealth Is Our Campus

Extension is a joint program of Virginia Tech, Virginia State University, the U.S. Department of Agriculture, and state and local governments.

Virginia Cooperative Extension programs and employment are open to all, regardless of race, color, religion, sex, age, veteran status, national origin, or political affiliation. An equal opportunity/affirmative action employer.

## (4) Report Interpretation

### Louisa County Household Water Quality Program

#### INTERPRETING YOUR HOUSEHOLD WATER QUALITY ANALYSIS REPORT

##### IRON

Iron in water does not usually present a health risk. It can, however, be very objectional if present in amounts greater than 0.3 mg/l. Excessive iron can leave red-orange-brown stains on plumbing fixtures and laundry. It may give water and/or beverages a bitter, metallic taste and discolor beverages.

##### MANGANESE

Manganese does not present a health risk. However, if present in amounts greater than 0.05 mg/l it may give water a bitter taste and produce black stains on laundry, cooking utensils, and plumbing fixtures.

##### HARDNESS

Hardness is a measure of calcium and magnesium in water. Hard water does not present a health risk. However, it keeps soap from lathering, decreases cleaning action of soaps and detergents, leaves soap "scum" on plumbing fixtures, and leaves scale deposits on water pipes and hot water heaters. Softening treatment is highly recommended for very hard water (above 180 mg/l). Water with a hardness of about 50 mg/l or less does not need softening. Water hardness may also be reported in units of grains per gallon, or gpg (1 gpg = 17.1 mg/l hardness). In all but extremely hard water situations, it may be desirable to soften only the hot water.

##### SULFATE

High sulfate concentrations may result in adverse taste as well as cause a laxative effect. The Secondary Maximum Contaminant Level for sulfate is 250 mg/l. Sulfates are generally naturally present in groundwater and be linked to other sulfur-related problems, such as hydrogen sulfide gas. This gas may be caused by the action of sulfate reducing bacteria as well as other types of bacteria on decaying organic matter. While it is difficult to test for the presence of hydrogen sulfide gas in water, it can be easily detected by its characteristic "rotten egg" odor which may be more noticeable in hot water. Water containing this gas may also corrode iron and other metals in the water system as well as stain plumbing fixtures and cooking utensils.

##### CHLORIDE

Chloride in drinking water is not a health risk. Natural levels of chlorides are low; high levels in drinking water usually indicate contamination from a septic system, road salts, fertilizers, industry, or animal wastes. High levels of chloride may speed corrosion rates of metal pipes, and causing pitting and darkening of stainless steel. The EPA has set a Secondary Maximum Contaminant Level for chloride of 250 mg/l.

##### FLUORIDE

Fluoride is of concern primarily from the standpoint of its effect on teeth and gums. Small concentrations of fluoride are considered to be beneficial in preventing tooth decay while moderate amounts can cause brownish discoloration of teeth and high fluoride concentrations can lead to tooth and bone damage. For these reasons, the EPA has set both a Secondary Maximum Contaminant Level and a Maximum Contaminant Level of 2 and 4 mg/l, respectively.

##### TOTAL DISSOLVED SOLIDS (TDS)

High concentrations of dissolved solids may cause adverse taste effects and may also lead to increased deterioration of household plumbing and appliances. The EPA Secondary Maximum Contaminant Level is 500 mg/l total dissolved solids.

##### pH

The pH of water indicates whether it is acidic (below 7.0) or alkaline (above 7.0). Acidic water can cause corrosion in pipes, and may cause toxic metals from plumbing systems, such as copper and lead, to be dissolved in drinking water. Dissolved copper may give water a bitter or metallic taste, and produce blue-green stains on plumbing fixtures. The life of plumbing systems may be shortened due to corrosion requiring expensive repair and replacement of water pipes and plumbing fixtures. The use of plastic pipes throughout the water distribution system should lessen these concerns. Water with a pH below 6.5 is considered to be acidic enough to require treatment. Alkaline water with a pH above 8.5 is seldom found naturally, and may indicate contamination by alkaline industrial wastes. The EPA has set a suggested range of between 6.5 and 8.5 on the pH scale for drinking water.

Virginia Cooperative Extension programs and employment are open to all, regardless of race, color, religion, sex, age, veteran status, national origin, disability, or political affiliation. An equal opportunity/affirmative action employer.

Issued in furtherance of Cooperative Extension work, Virginia Polytechnic Institute and State University, Virginia State University, and the U.S. Department of Agriculture cooperating. Clark C. Jones, Director, Virginia Cooperative Extension, Virginia Tech, Blacksburg Lorenza W. Lyons, Interim Administrator, 1890 Extension Program, Virginia State, Petersburg.

# Report Interpretation (cont.)

## SATURATION INDEX

The saturation (Langlier) index, in addition to pH, is used to evaluate the extent of potential corrosion of metal pipes, plumbing fixtures, etc. It is a calculated value based on the calcium concentration, total dissolved solids concentration, measured pH, and alkalinity, and is a measure of the scale formation potential of the water. A saturation index greater than zero indicates that protective calcium carbonate deposits may readily form on pipe walls. A saturation index less than zero indicates that the water does not have scale-forming properties and pipes may be subject to corrosion. Saturation index values between -1 and +1 are considered acceptable for household water supplies. **NOTE: Values of less than -1 need not be of concern if the water is not acidic (indicated by a pH of 7.0 or above).** Water softener owners may note a saturation index reading lower than desired. While these treatment devices correct hardness, they may enhance the corrosion potential of the water. Concerns about resulting drinking water quality may be lessened by softening only the hot water or bypassing drinking water lines.

## COPPER

The EPA drinking water standard for copper is 1.3 mg/l, based on concerns about acute gastrointestinal illness. Since dissolved copper also leaves blue-green stains on plumbing fixtures, a Secondary Maximum Contaminant Level of 1.0 mg/l is also provided for copper. While copper in household water most often comes from the corrosion of brass and copper plumbing materials, this type of contamination is not likely to be detected under the sampling procedure followed in this program which called for flushing the water lines. Therefore, any excessive amounts of copper from the water source itself may indicate contamination from industrial wastes or dumps/landfills.

## SODIUM

Excessive sodium has been linked to problems with high blood pressure, and heart and kidney diseases. Moderate quantities of sodium in drinking water are not considered harmful since an individual normally receives most (over 90%) of his/her sodium intake from food. For those on low-sodium diets, both the American Heart Association and EPA suggest 20 mg/l as a maximum level for sodium in drinking water; a physician should be consulted in individual cases. Water softening by ion-exchange will increase sodium levels in water. To reduce sodium in drinking water requiring such treatment, soften only the hot water or bypass drinking water lines.

## NITRATE

High levels of nitrate may cause methemoglobinemia or "blue-baby" disease in infants. Though the EPA has set a Maximum Contaminant Level for nitrate-nitrogen of 10 mg/l, they suggest that water with greater than 1 mg/l be used with caution for feeding infants. Levels of higher than 3 mg/l may indicate excessive contamination of water supply by commercial fertilizers as well as organic wastes from septic systems or farm animal operations.

## TOTAL COLIFORM BACTERIA

Microbiological contamination of drinking water can cause short term gastrointestinal disorders, resulting in cramps and diarrhea that may be mild to very severe. Other diseases of concern are Viral Hepatitis A, salmonella infections, dysentery, typhoid fever, and cholera. While coliform bacteria do not cause disease, they serve as indicators of the possible presence of disease bacteria. Coliform bacteria are always present in the digestive systems of humans and animals and could also come from natural sources such as soil or decaying vegetation. Analysis for total coliform bacteria is the EPA standard test for microbiological contamination of a water supply. A positive test result reported as "present" indicates the presence of coliform bacteria and is followed by a test for fecal coliform bacteria.

## E COLI

A test for fecal coliform bacteria is necessary to determine whether or not any coliform bacteria present are from human and/or animal waste. A positive E. coli test result reported as "present" indicates that waste from a septic system or nearby animals is likely contaminating the water supply.

## Glossary

EPA - U. S. Environmental Protection Agency

mg/l - Concentration unit of milligrams per liter in water, equivalent to one part per million (ppm).

**Maximum Contaminant Level (MCL)** - Legally enforceable national standard set by the EPA to protect the public from exposure to water hazards. Standards only apply to public drinking water systems, but, they also serve as a guide for individual water supplies.

**Secondary Maximum Contaminant Level (SMCL)** - Concentration limits for nuisance contaminants and physical problems. These standards are not enforced by governments. However, they are useful guidelines for individual water supplies.

Compiled by Blake Ross, Extension Agricultural Engineer, and Kathy Parron, Extension Specialist, Housing, Virginia Tech, Blacksburg, VA

June 1999

This material is based upon work supported by the U. S. Department of Agriculture-Extension Service.

Louisa County

HOUSEHOLD WATER QUALITY PROGRAM EVALUATION SURVEY

Please answer each question below as instructed in reference to your household water supply only. Your answers are completely confidential and cannot be identified with any individual participant.

1. Have you had a laboratory test of your water supply before this Household Water Quality Education Program? Yes \_\_\_\_\_ No \_\_\_\_\_

If Yes, about what year was your last test? \_\_\_\_\_

2. What prompted you to participate in this program? (Check all that apply.)

- \_\_\_\_\_ Concern about safety of my water supply
\_\_\_\_\_ Nuisance problems such as staining, objectionable taste or odor, corrosion, etc.
\_\_\_\_\_ Follow-up to previous test of my water supply
\_\_\_\_\_ Other (explain) \_\_\_\_\_

3. Did your household water analysis in this program show that your water was unsatisfactory for any of the following tests? (Check one response for each test.)

Table with 3 columns: Test Name, Yes, No. Rows include Nitrate, Sodium, Iron, Manganese, Hardness, pH.

4. What were the results of the tests for the following? (Check one response for each test.)

Table with 3 columns: Test Name, Present, Absent. Rows include Total coliform bacteria, E. coli bacteria.

5. Since receiving the results of your water quality analysis, which of the following measures do you plan to take, or have already taken, to improve the quality of your water supply? (Check all that apply.)

- \_\_\_\_\_ Contact a state agency such as the Health Dept., Dept. of Environmental Quality, etc. for assistance or additional information
\_\_\_\_\_ Seek additional water testing from a laboratory
\_\_\_\_\_ Determine source of undesirable condition
\_\_\_\_\_ Pump out septic system
\_\_\_\_\_ Improve physical condition of water source (well, spring, or cistern)
\_\_\_\_\_ Shock chlorinate water system
\_\_\_\_\_ Obtain new water source
\_\_\_\_\_ Use bottled water for drinking/cooking
\_\_\_\_\_ Temporary disinfection, such as boiling water
\_\_\_\_\_ Purchase or rent water treatment equipment
\_\_\_\_\_ Improve functioning of existing water treatment equipment
\_\_\_\_\_ Take other measures to eliminate or reduce contaminant(s) in your water (explain)

Horizontal lines for additional responses.

Haven't done anything because \_\_\_\_\_

Horizontal line for additional responses.

Virginia Cooperative Extension programs and employment are open to all, regardless of race, color, religion, sex, age, veteran status, national origin, disability, or political affiliation. An equal opportunity/affirmative action employer. Issued in furtherance of Cooperation Extension work, Virginia Polytechnic Institute and State University, Virginia State University, and the U.S. Department of Agriculture cooperating. Clark Jones, Director, Virginia Cooperative Extension, Virginia Tech, Blacksburg; Lorenzo W. Lyons, Administrator, 1890 Extension Program, Virginia State, Petersburg.

# Post-Program Survey (cont.)

The following questions are designed to provide us with a profile of the total audience we've reached with this program. **Be assured that answers cannot be identified with individual participants.**

6. How many years have you lived at your present location? \_\_\_\_\_
7. Number of persons in your household. \_\_\_\_\_
8. What is the highest grade in school you've completed? (Check one.)
- \_\_\_\_\_ Grade school
  - \_\_\_\_\_ Some high school
  - \_\_\_\_\_ High school graduate
  - \_\_\_\_\_ Some education after high school
  - \_\_\_\_\_ College graduate

9. What is your family income before taxes? (Check one.)
- \_\_\_\_\_ Less than \$10,000
  - \_\_\_\_\_ \$10,000 to \$14,999
  - \_\_\_\_\_ \$15,000 to \$19,999
  - \_\_\_\_\_ \$20,000 to \$24,999
  - \_\_\_\_\_ \$25,000 to \$34,999
  - \_\_\_\_\_ \$35,000 to \$49,000
  - \_\_\_\_\_ \$50,000 or more

10. Other comments about the Household Water Quality Education Program:

---

---

---

11. Are there other educational programs that you would like to see offered by the Louisa County Extension Office?

---

---

12. How did you hear about this Household Water Quality Education Program? (Check all that apply.)

- \_\_\_\_\_ Newspaper
- \_\_\_\_\_ Radio
- \_\_\_\_\_ Television
- \_\_\_\_\_ Extension Newsletter
- \_\_\_\_\_ Flyer from child's school
- \_\_\_\_\_ Friend or Neighbor
- \_\_\_\_\_ Other (explain)

Thank you for your participation. Please return this survey form by **September 1, 1999**. A postage-paid envelope has been provided for your use in returning this form to:

Jim Riddell, Louisa County  
Virginia Cooperative Extension  
Extension Distribution Center  
112 Landsdowne Street  
Blacksburg, VA 24060-9984



# NOTES

---

---

Virginia Cooperative Extension programs and employment are open to all, regardless of race, color, religion, sex, age, veteran status, national origin, disability, or political affiliation. An equal opportunity/affirmative action employer. Issued in furtherance of Cooperative Extension work, Virginia Polytechnic Institute and State University, Virginia State University, and the U.S. Department of Agriculture cooperating. J. David Barrett, Director, Virginia Cooperative Extension, Virginia Tech, Blacksburg; Lorenza W. Lyons, Administrator, 1890 Extension Program, Virginia State, Petersburg.

VT/002/0800/175/210589/442933