

Tazewell County Water System - 1998
Sensitivity Run 1: FX =.20

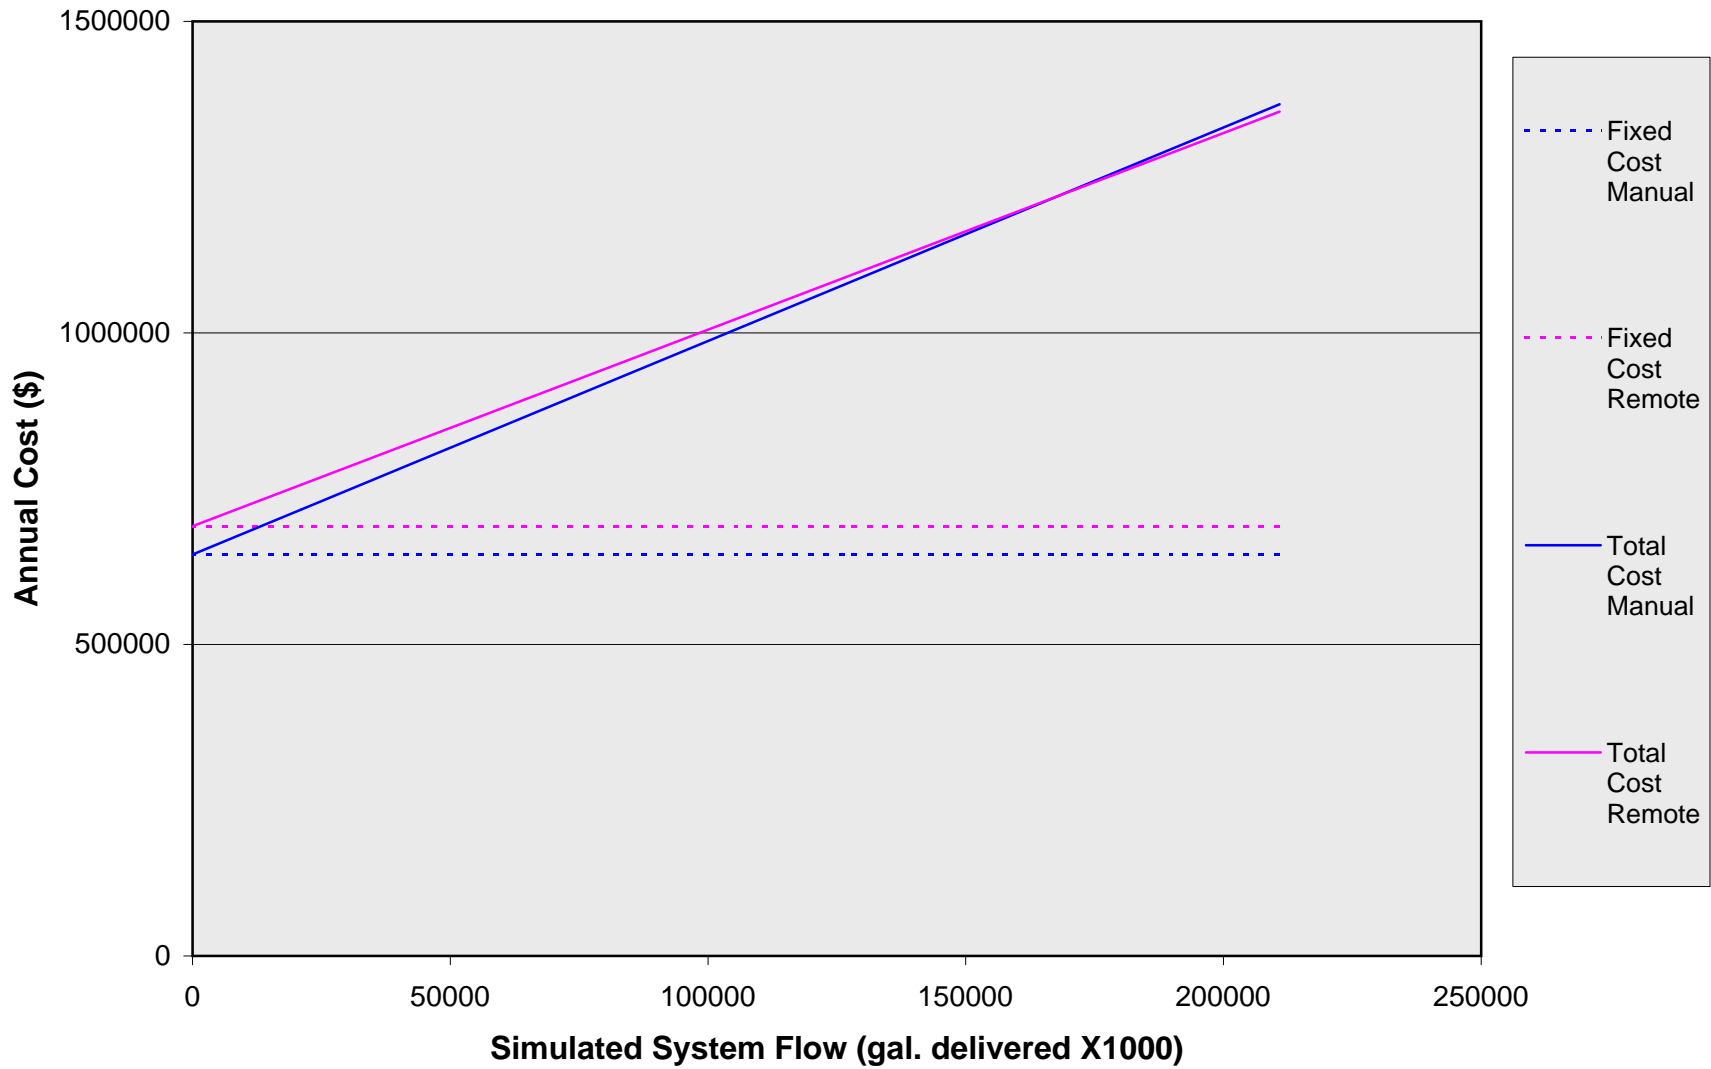


Exhibit 3.19. Sensitivity run 1 (FX = .2) break-even chart.