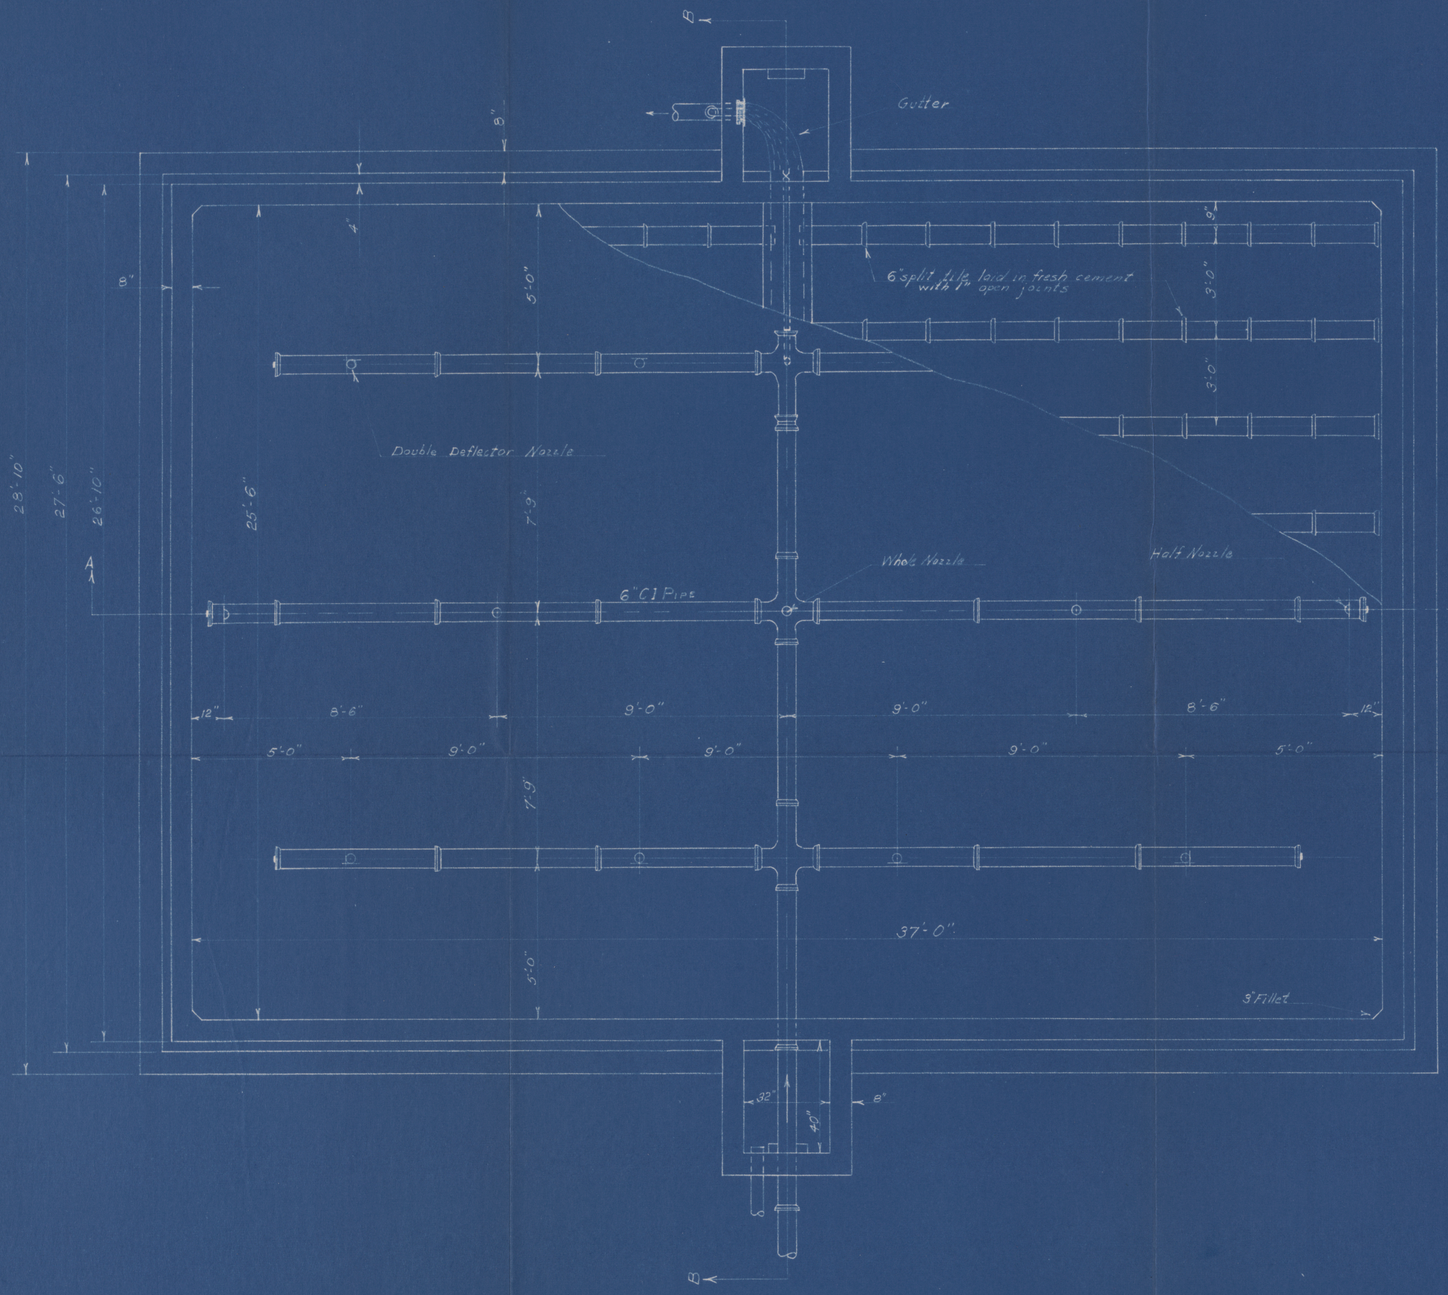

PLAN

SECTION B-B

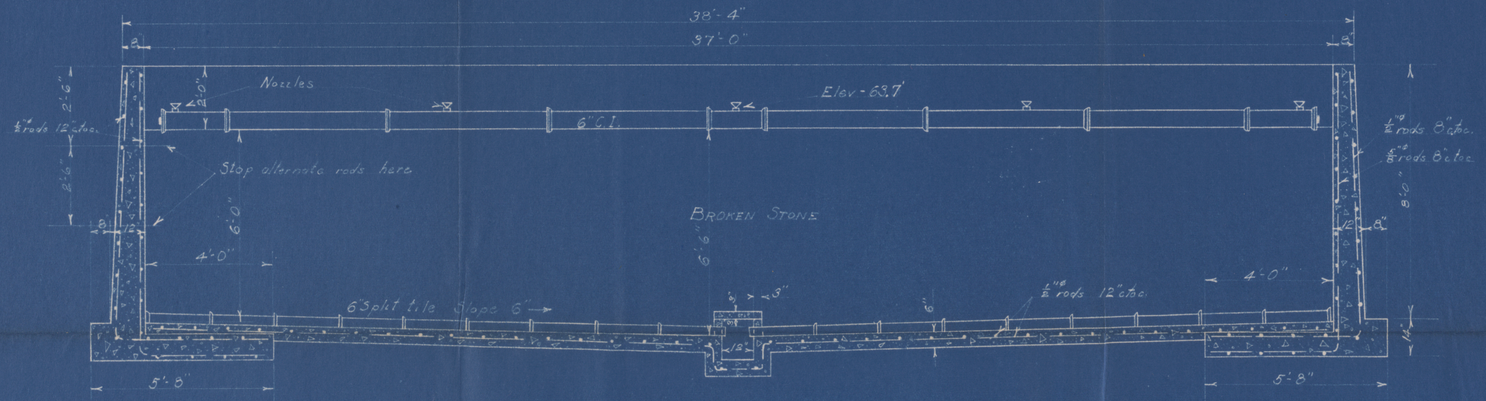

SECTION AA

Concrete to be 2500 lbs. per sq. in.
Reinforcing to be billet steel
16000 lbs. per sq. in.

PLANS BY
PR. WM. CO. HEALTH DEPT.
C.L. RILEY, MED. DIR. J.R. SIMPSON, ENGR.

SEWERAGE SYSTEM
MANASSAS INDUSTRIAL SCHOOL
SPRINKLING FILTER

1304033A

Scale:- ⅜"=1'-0"

SHEET No. 3 of 4